

FLEETWOOD WINDOWS & DOORS TEST REPORT

SCOPE OF WORK

ASTM E283/E283M-19, ASTM E547-00(2016), ASTM E330/E330M-14(2021) and AAMA 1804-14 ON THEIR SERIES= 3200-T H - OUTSWING – SIDE HINGED DOOR

REPORT NUMBER

R6037.01-303-44 R1

TEST DATES

07/26/24 - 07/30/24

ISSUE DATE

07/31/24

REVISION DATE

08/07/24


PAGES

13

DOCUMENT CONTROL NUMBER

RT-R-AMER-Test-2776 (04/21/23)

© 2017 INTERTEK

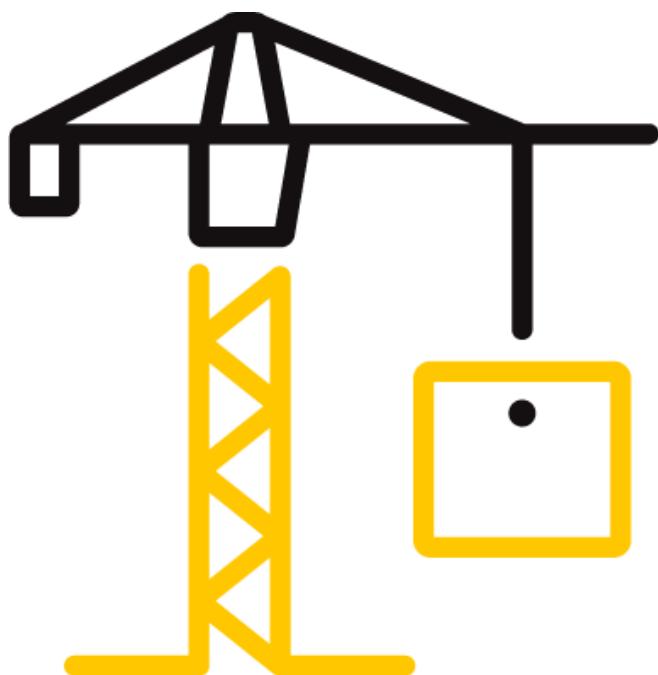

TEST REPORT FOR FLEETWOOD WINDOWS & DOORS

Report No.: R6037.01-303-44 R1

Date: 07/31/24

REPORT ISSUED TO**FLEETWOOD WINDOWS & DOORS**1 Fleetwood way
Corona, CA 92879**SECTION 1****SCOPE**

Architectural Testing, Inc. (an Intertek company) dba Intertek Building & Construction (B&C) was contracted by Fleetwood Window & Doors, 1 Fleetwood Way Corona, CA 92879 to perform testing in accordance with ASTM E283/E283M-19, ASTM E547-00(2016), ASTM E330/E330M-14(2021) and AAMA 1304-14 on their series 3200-T H - OUTSWING – SIDE HINGED DOOR. Results obtained are tested values and were secured by using the designated test methods. Testing was conducted at the Intertek Inc. test facility in Lake Forest, CA 92630.

This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. Intertek B&C will service this report for the entire test record retention period. The test record retention period ends four years after the test date. Test records, such as detailed drawings, datasheets, or other pertinent project documentation, will be retained for the entire test record retention period.

Unless differently required, Intertek reports apply the "Simple Acceptance" rule, also called "Shared Risk approach," of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.

SECTION 2**SUMMARY OF TEST RESULTS**

The specimen tested met the performance requirements listed herein.

For INTERTEK B&C:

COMPLETED BY:	Benjamin Johns	REVIEWED BY:	Tyler Westerling
TITLE:	Project Manager Building & Construction	TITLE:	Regional Manager Building and construction
SIGNATURE:		SIGNATURE:	
DATE:	08/07/24	DATE:	08/07/24

BAJ

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

TEST REPORT FOR FLEETWOOD WINDOWS & DOORS

Report No.: R6037.01-303-44 R1

Date: 07/31/24

SECTION 3

TEST METHODS

The test specimens were evaluated in accordance with the following methods.

ASTM E283/E283M-19, Standard Test Method for Determining Rate of Air Leakage Through Exterior Windows, Skylights, Curtain Walls, and Doors Under Specified Pressure Differences Across the Specimen

ASTM E547-00(2016), Standard Test Method for Water Penetration of Exterior Windows, Skylights, Doors, and Curtain Walls by Cyclic Static Air Pressure Difference

ASTM E330/E330M-14(2021), Standard Test Method for Structural Performance of Exterior Windows, Doors, Skylights and Curtain Walls by Uniform Static Air Pressure Difference

AAMA 1304-14, Voluntary Specification for determining Forced Entry Resistance of Side hinged Door Systems.

SECTION 4

MATERIAL SOURCE/INSTALLATION

Test specimen was provided by the client.

The specimen was installed into a Douglas-Fir wood buck. The rough opening allowed for a 1/4" shim space and the exterior perimeter of the specimen was sealed to the test buck. Installation of the tested product was performed by Intertek Inc.

LOCATION	ANCHOR DESCRIPTION	ANCHOR SPACING
At corners	#6 X 2" Philips flat head phosphate wood screw	2" from each corner
Perimeter of the frame	#6 X 2" Philips flat head phosphate wood screw	12" perimeter of the jambs and the head
sill	GE 100% all-purpose silicone	Full length of the sill

SECTION 5

LIST OF OFFICIAL OBSERVERS

NAME	TITLE	COMPANY
Benjamin Johns	Project Manager	Intertek B&C

TEST REPORT FOR FLEETWOOD WINDOWS & DOORS

Report No.: R6037.01-303-44 R1

Date: 07/31/24

**SECTION 6
EQUIPMENT**

Equipment calibration records are available for review at 130 Derry Court, York, PA 17406.

**SECTION 7
TEST SPECIMEN DESCRIPTION****Product Type:** Side Hinged Door**Series/Model:** 3200-T H-Outswing**Product Size:****Test Specimen #1**

OVERALL, AREA:	WIDTH		HEIGHT	
	millimeters	inches	millimeters	inches
3.34 m ² (35.92 ft ²)				
Overall size	1075	42.32	3050	120.08
Operable Panel	1017	40.04	2292	117.81

Frame Construction:

MEMBER	MATERIAL	DESCRIPTION
Head, Sill & Jambs	Aluminum	Extruded

	JOINERY TYPE	DETAIL
All corners	Butt	Attached with screws.

Panel Construction:

MEMBER	MATERIAL	DESCRIPTION
Head, Sill & Jambs	Aluminum	Extruded

	JOINERY TYPE	DETAIL
All corners	butt	Attached with screws

Reinforcement: *No reinforcement was utilized.*

TEST REPORT FOR FLEETWOOD WINDOWS & DOORS

Report No.: R6037.01-303-44 R1

Date: 07/31/24

Weatherstripping:

DESCRIPTION	QUANTITY	LOCATION
Bulb Gasket	2 rows	At the perimeter of the jambs and head of the frame.
Bulb Gasket	2 rows	At the perimeter of the frame on the exterior side.
Bulb Gasket	1 Row	At the perimeter of the operable panel

Glazing: *No conclusions of any kind regarding the adequacy or inadequacy of the glass in any glazed test specimen(s) can be made.*

GLASS TYPE	SPACER TYPE	INTERIOR LITE	EXTERIOR LITE	GLAZING METHOD
1" IG	Aluminum/Butyl	1/4" Tempered	1/4" Tempered	Exterior glazing bead and interior glazing tape.

LOCATION	QUANTITY	DAYLIGHT OPENING	GLASS BITE
		millimeters	
Operable panel	1	825 X 2800	32.48 X 110.24 9/16"

Drainage:

METHOD	SIZE	QUANTITY	LOCATION
Weep Hole	1/4" wide by 5/8" high	2	1 @ 1-1/2" on center from left jamb on the sill. 1 @ 1-1/2" on center from the right jamb on the sill.

Hardware:

DESCRIPTION	QUANTITY	LOCATION
Lock	1	78" on center from the head of the operable panel on the left jamb. Interior view
Hinge	4	1 @ 10-1/2" 1 @ 35" 1 @ 83" 1 @ 107" from the head of the operable panel on the right jamb of the operable panel. Interior view.
Shoot bolt & keeper	1	1 shoot bolt at the left jamb of the operable panel locking into the keeper at the head and the sill. Interior view.

TEST REPORT FOR FLEETWOOD WINDOWS & DOORS

Report No.: R6037.01-303-44 R1

Date: 07/31/24

SECTION 8**TEST RESULTS**

The temperature range during testing was (82°F). The results are tabulated as follows:

Test Specimen #1:

TITLE OF TEST	RESULTS	ALLOWED	NOTE
Air Leakage, Infiltration per ASTM E283 at 75 Pa (1.57 psf)	1.23 L/s/m ² (0.26 cfm/ft ²)	1.5 L/s/m ² (0.3 cfm/ft ²) max.	1
Air Leakage, Exfiltration per ASTM E283 at 75 Pa (1.57 psf)	1.18 L/s/m ² (0.25 cfm/ft ²)	1.5 L/s/m ² (0.3 cfm/ft ²) max.	1
Water Penetration, per ASTM E547 at 150 Pa (3.13 psf)	Pass	No leakage	2
Uniform Load Deflection, per ASTM E330 Deflections taken between the lock and the head of the specimen. +2880 Pa (+60.15 psf) -2880 Pa (-60.15 psf)	0.10" 0.48"	Report only	3,4,5,6
Uniform Load Structural, per ASTM E330 Permanent set taken between the lock and the head of the specimen. +4320 Pa (+90.23 psf) -4320 Pa (-90.23 psf)	<0.04" 0.03"	0.31" max. 0.31" max.	3,4,5,6
Forced Entry Resistance, per AAMA 1304	Pass	No entry	



Total Quality. Assured.

25800 Commercentre Drive
Lake Forest, California 92630

Telephone: 559-233-8705
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR FLEETWOOD WINDOWS & DOORS

Report No.: R6037.01-303-44 R1

Date: 07/31/24

Note 1: Test Date 07/26/24 / Time: 11:00 AM (Air Note Only)

Note 2: Without insect screen.

Note 3: The client opted to start at a pressure higher than the minimum required. Test results are reported under Optional Performance.

Note 4: The deflections reported are not limited by AAMA/WDMA/CSA 101/I.S.2/A440 for this product designation. The deflection data is recorded in this report for special code compliance and information only.

Note 5: Loads were held for 10 seconds.

Note 6: Tape and film were used to seal against air leakage during structural testing. In our opinion, the tape and film did not influence the results of the test.



Total Quality. Assured.

25800 Commercentre Drive
Lake Forest, California 92630

Telephone: 559-233-8705
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR FLEETWOOD WINDOWS & DOORS

Report No.: R6037.01-303-44 R1

Date: 07/31/24

SECTION 9

DRAWINGS

The test specimen drawings have been reviewed by Intertek B&C and are representative of the test specimen reported herein. Test specimen construction was verified by Intertek B&C per the drawings included in this report. Any deviations are documented herein or on the drawings.

Note: Complete drawings packet on file with Intertek B&C.

TEST SPECIMEN DESCRIPTIONS

1. SERIES / MODEL: Series 3200-T
2. PRODUCT TYPE: HINGED DOOR- SINGLE; HINGED DOOR- DOUBLE

GENERAL NOTES

1. BUCKING OPENINGS & BUCKING FASTENERS MUST BE PROPERLY DESIGNED & INSTALLED TO TRANSFER LOADS TO THE STRUCTURE AND TO BE REVIEWED BY BUILDING OFFICIAL.
2. ALL HARDWARE & FASTENERS SHALL BE IN ACCORDANCE WITH THESE DRAWINGS & MAY NOT VARY UNLESS SPECIFICALLY MENTIONED ON THE DRAWINGS.
3. MATERIALS, INCLUDING BUT NOT LIMITED TO STEEL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF AAMA AND FLORIDA BUILDING CODE.

SPECIFICATIONS

1. AAMA/WDMA/CSA 101/I.S.2/A440
2. A440 S1 (CANADIAN SUPPLEMENT)

PAGE #
DETAIL #

1 H-OUTSWING
Series 3200-T
QTY: 1
GLASS: 1"; 6mm, A.S., 6mm-T

NOTES:
1. OUTSWING
2. NAIL-ON FRAME
3. 3-POINT LOCK
4. INACTIVE LEVER SHOOTBOLTS

SPEC 4: A440

CORNERS CONSTRUCTION


1. FRAME CORNER: THE JAMBS ARE BUTTED TO THE HEAD AND ATTACHED WITH SCREWS.
2. PANEL CORNER: THE HORIZONTAL RAILS ARE BUTTED TO THE VERTICALS AND ATTACHED WITH 3/8-16 BOLTS, NUTS, BACK-UP PLATE AND WELDED CORNER KEY.

ANCHOR SCHEDULE

1. OPENING TYPE (SUBSTRATE): 2X- WOOD FRAME, STEEL STUD, CONCRETE
2. FRAME: NO. 10 SCREW, 8" FROM END, 16" O.C. MAX.
MINIMUM EMBEDMENT: 1 1/2"
MINIMUM EDGE DISTANCE: 3/4"

GLAZING : SEE PAGE 3

*FRAME ANCHOR REQUIREMENTS TABLE			
OPENING TYPE (SUBSTRATE)	FRAME TO OPENING FASTENER TYPE	MINIMUM EMBEDMENT	MINIMUM EDGE DIST.
2X WOOD FRAME OR BUCK	(1) NO. 8 SMS SCREW	1 1/2"	3/4"
MIN. 18 GA. 33 KSI STEEL STUD	(1) NO. 8 SMS SCREW	FULL	3/8"
CMU/CONCRETE	(2) 3/16" CONCRETE SCREWS	1 1/4"	2 5/8"
(1) SMS SCREWS			
(2) CONCRETE SCREWS SHALL BE 3/16" ITW TAPCON			
		COMMENTS	

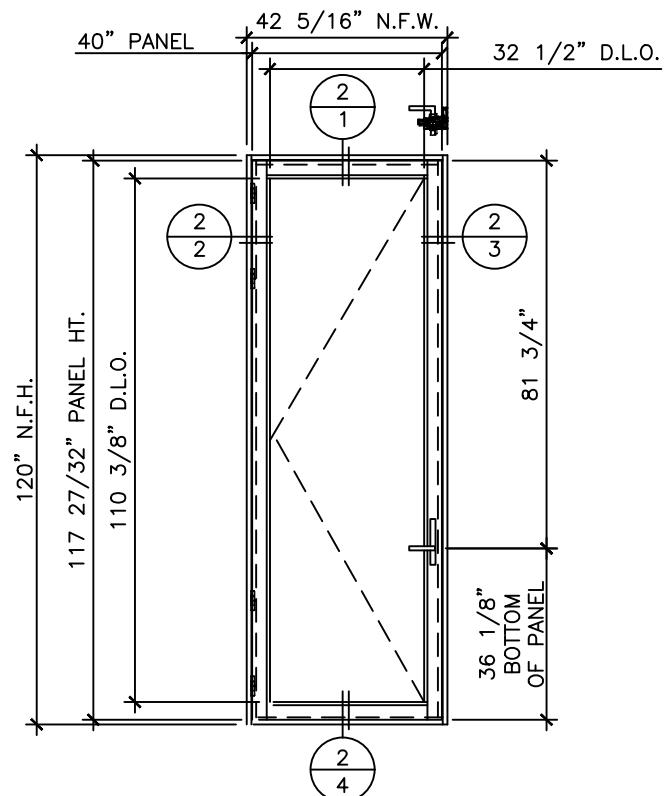

intertek
Total Quality. Assured.

Report #: R6037.01

Date: 07/31/24

Verified by: 

FLEETWOOD
WINDOWS & DOORS


1 FLEETWOOD WAY
CORONA, CA 92879
www.fleetwoodusa.com

NOTES: PROJECT #:
CUSTOMER: FLEETWOOD WINDOWS AND DOORS
JOB NAME: 3200-T TESTING


SCALE :
N.T.S.

DRAWING NO. :
(1)


SHEET :
1 OF 3

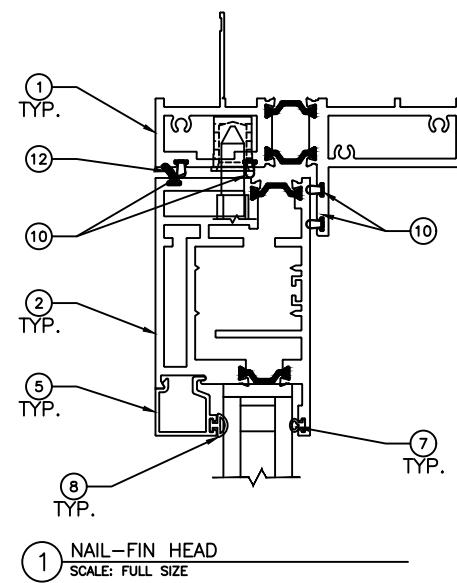


1 NAIL-FIN HEAD
SCALE: FULL SIZE

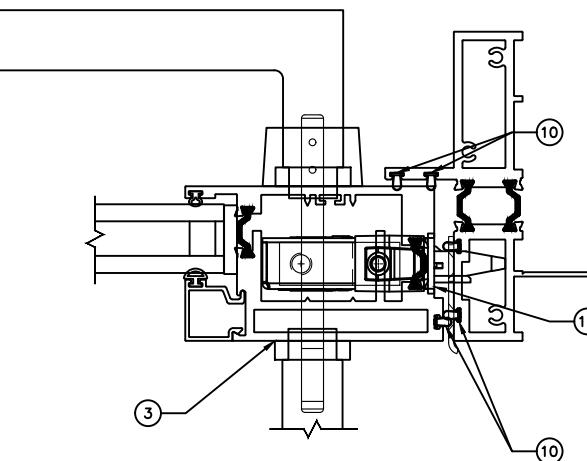


3 MEETING STILE
SCALE: FULL SIZE

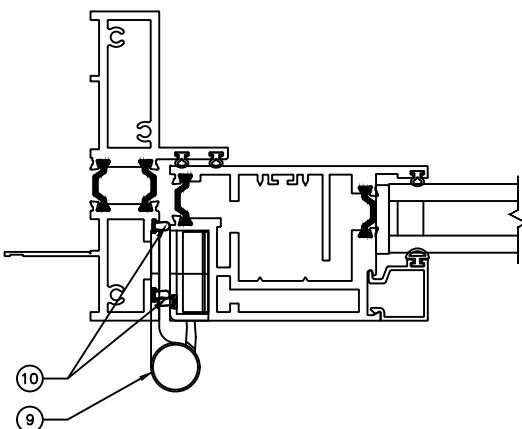

2 NAIL-FIN JAMB
SCALE: FULL SIZE

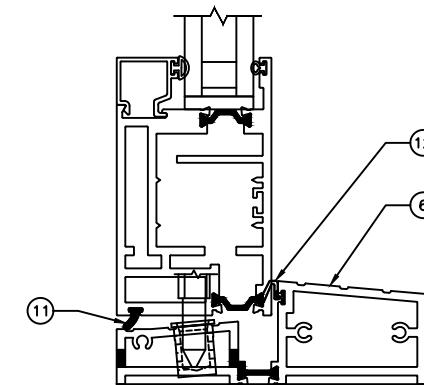

4 STANDARD OUT-SWING SILL
SCALE: FULL SIZE

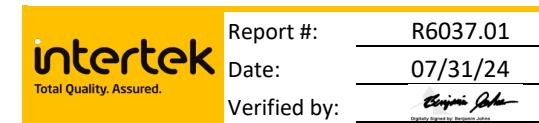

intertel
Total Quality. Assured.

Report #: R6037.01
Date: 07/31/24
Verified by: Benjamin John

The logo for Fleetwood Windows & Doors. It features the word "FLEETWOOD" in a large, bold, black, sans-serif font. Below it, the words "WINDOWS & DOORS" are written in a smaller, black, sans-serif font. The "F" in "FLEETWOOD" is stylized with a diagonal cut, and the "W" in "WINDOWS" has a similar diagonal cut. A black triangle is positioned to the left of the text.

SCALE :
NTS

DRAWING NO.
(2)


SHEET 8

2 OF 3


SHEET :

SHEET :

2 OF 3

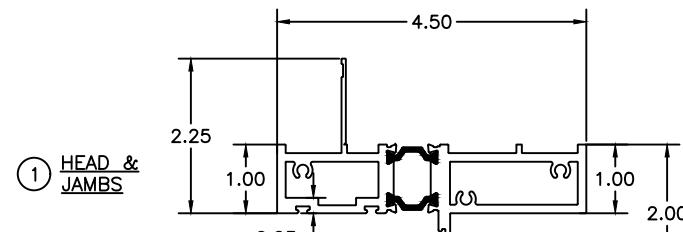


② HINGE STILE
TOP RAIL
BOTTOM RAIL

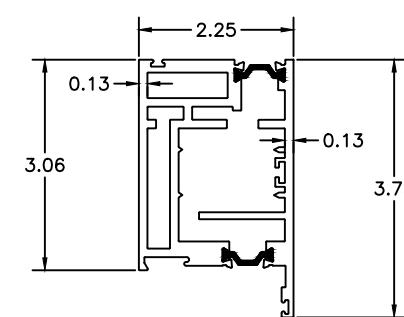


Technical drawing showing a cross-section of a door lock stile assembly. The drawing includes a legend with the number 3 and the text 'ACTIVE LOCK STILE'. Dimension lines indicate the height of 3.06 and the width of 3.62. A vertical dimension line on the right indicates a total height of 3.75, with a note '0.13' indicating the thickness of the top plate.


⑦ MINI BULB VINYL




8) LARGE BULB VINYL




10 Q-LON FOAM SEAL



11 Q-LON FOAM SEAL




12 Q-LON FOAM SEAL



BILL OF MATERIALS				
ITEM NO.	FWID	PART DESCRIPTION	VENDOR NAME	VENDOR PART NO.
EXTRUSIONS				
1	3208	OUT-SWING FRAME	SIERRA	700753-700759
2	3203	HINGE STILE/TOP/BOTOM RAIL	SIERRA	700755-906273
3	3204	ACTIVE STILE	SIERRA	700756-906274
5	3907	1" GLASS STOP	MERIT	10887
6	3202	OUT-SWING SILL	MERIT	11737-10892
HARDWARE				
7	25199	MINI BULB VINYL	TREMCO	TX20801E
8	25031	LARGE BULB VINYL	TREMCO	TX19638E
9	25232	ADJUSTABLE HINGE	TRUTH	48.01.5E.111
0	25190	Q-LON (250X190)	SCHLEGEI	PQ21BL-00000
11	25196	Q-LON 32390	AMESBURY	32390
2	25059	Q-LON FOAM SEAL (QEZ 376)	AMESBURY	QEZ 376
3	27389	ACTIVE 3 POINT LOCK	TRUTH	1900117


GLAZING DETAILS

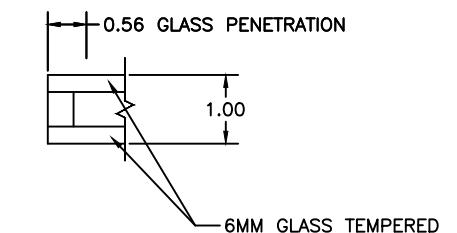

(G1) GLAZING DETAIL



5 1" GLASS STOP




TEST REPORT FOR FLEETWOOD WINDOWS & DOORS

Report No.: R6037.01-303-44 R1

Date: 07/31/24

SECTION 10**LOCATION OF AIR SEAL**

The air seal between the test specimen and the test wall is detailed below. The seal is made of foam weatherstripping and is attached to the edge of the test specimen buck. The test specimen buck is placed against the test wall and clamped in place, compressing the weatherstripping and creating a seal.

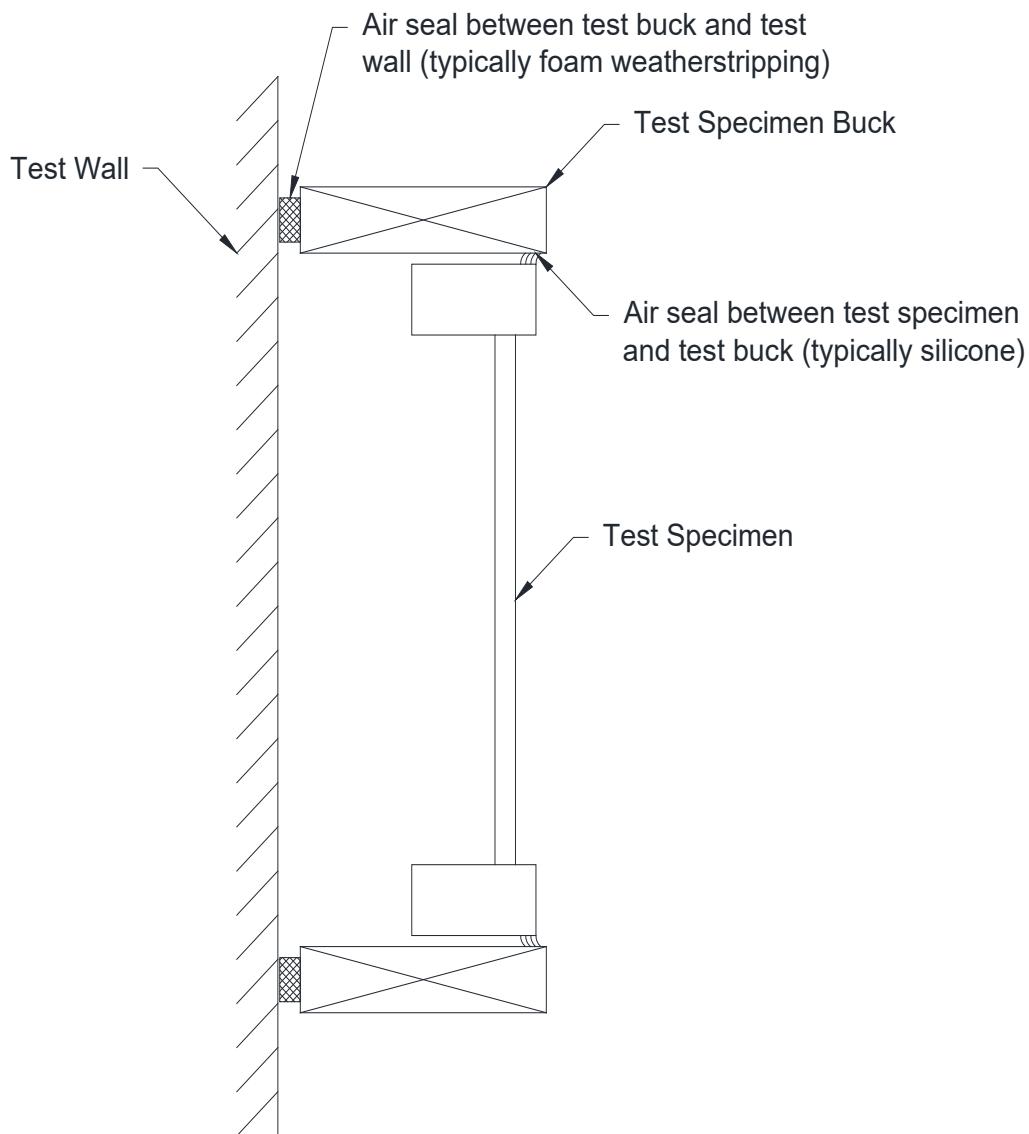



Total Quality. Assured.

25800 Commercentre Drive
Lake Forest, California 92630

Telephone: 559-233-8705
Facsimile: 717-764-4129
www.intertek.com/building

TEST REPORT FOR FLEETWOOD WINDOWS & DOORS

Report No.: R6037.01-303-44 R1

Date: 07/31/24

SECTION 11

REVISION LOG

REVISION #	DATE	PAGES	REVISION
0	07/31/24	N/A	Original Report Issue Add series type. Adjust height of the panel.
1	08/07/24	1,2,4,5	Add joinery detail. Add inside view to all hardware descriptions. Fix size of the panel.