




Series 3800-T w/ Series 350-T Aluminum Awning Window w/ Thermal Break Frame "IMPACT"


GENERAL NOTES

1. This product has been evaluated and is in compliance with the 7th Edition (2020) Florida Building Code (FBC) structural requirements including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with Section 1626 of the Florida Building Code and does not require an impact resistant covering.
4. When used in areas outside of the "HVHZ" requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. This product meets water infiltration requirements for "HVHZ".
8. Gaskets and setting blocks shall comply with Section 2411.3.4 of the FBC.
9. Aluminum components, including fasteners, shall meet the requirements of FBC Section 2003.

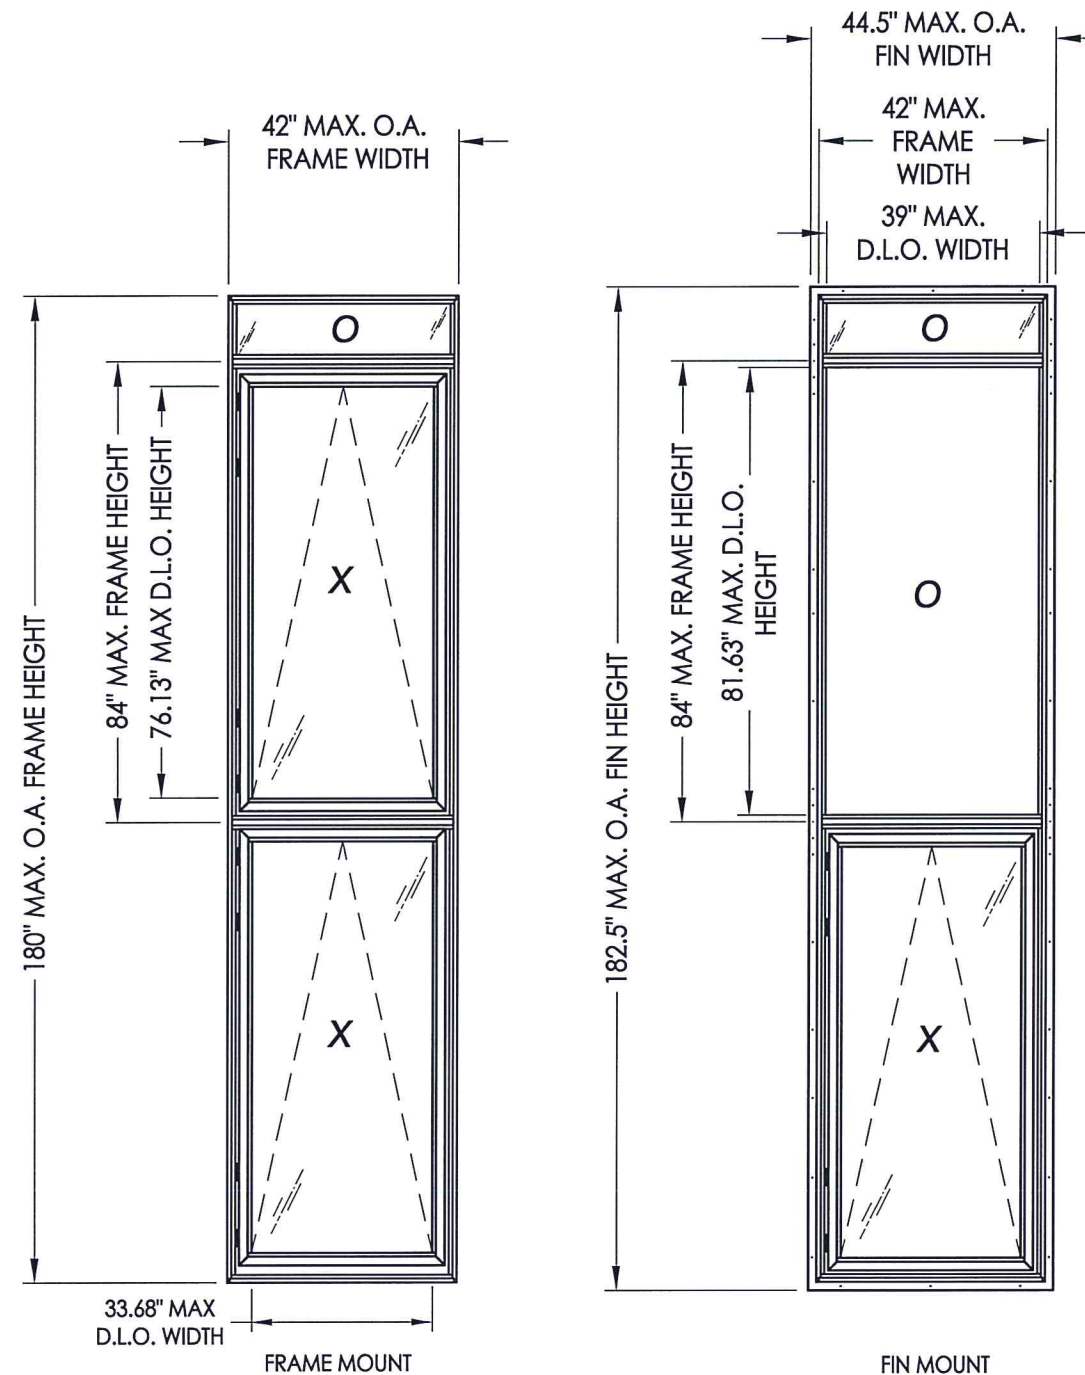

OVERALL FIN DIMENSION	OVERALL FRAME DIMENSION	MAX. D.L.O. DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)	
				POSITIVE	NEGATIVE
44.5" X 182.5"	42.0" X 180.0"	33.68" X 76.13" (X)	G1, G2, G3, G4, G5, G6	+65.0	-65.0
		39.0" X 81.63" (O)	G7, G8, G9, G10, G11		

SHEET#	DESCRIPTION
1	Typical elevations, design pressures and general notes
2	Elevations
3	Horizontal cross sections
4	Vertical cross sections
5	Vertical cross sections
6	Buck & frame anchoring
7	Glazing details (Operable)
8	Glazing details (Fixed)
9	Bill of materials and components


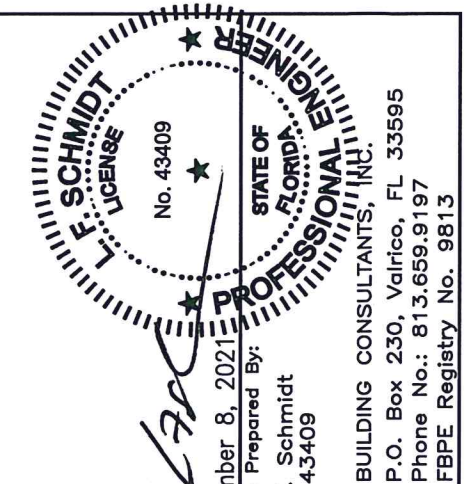


December 8, 2021
 Documents Prepared By:
 Lyndon F. Schmidt
 P.E. No. 43409
 R.W. BUILDING CONSULTANTS, INC.
 P.O. Box 230, Valrico, FL 33595
 Phone No.: 813.659.9197
 FBPE Registry No. 9813

PRODUCT: FLEETWOOD WINDOWS & DOORS
 PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES


NO.	DATE	REVISIONS
4	12/08/21	SERIES NAME CHANGE
3	8/10/20	UPDATE TO 7TH ED. (2020) FBC
2	8/07/17	UPDATE TO 6TH ED. (2017) FBC
1	8/22/16	RENUMBER DRAWINGS

DATE: 6/27/16
 SCALE: N.T.S.
 DWG. BY: JK
 CHK. BY: LFS
 DRAWING NO.: FL-14907.4
 SHEET 1 OF 9

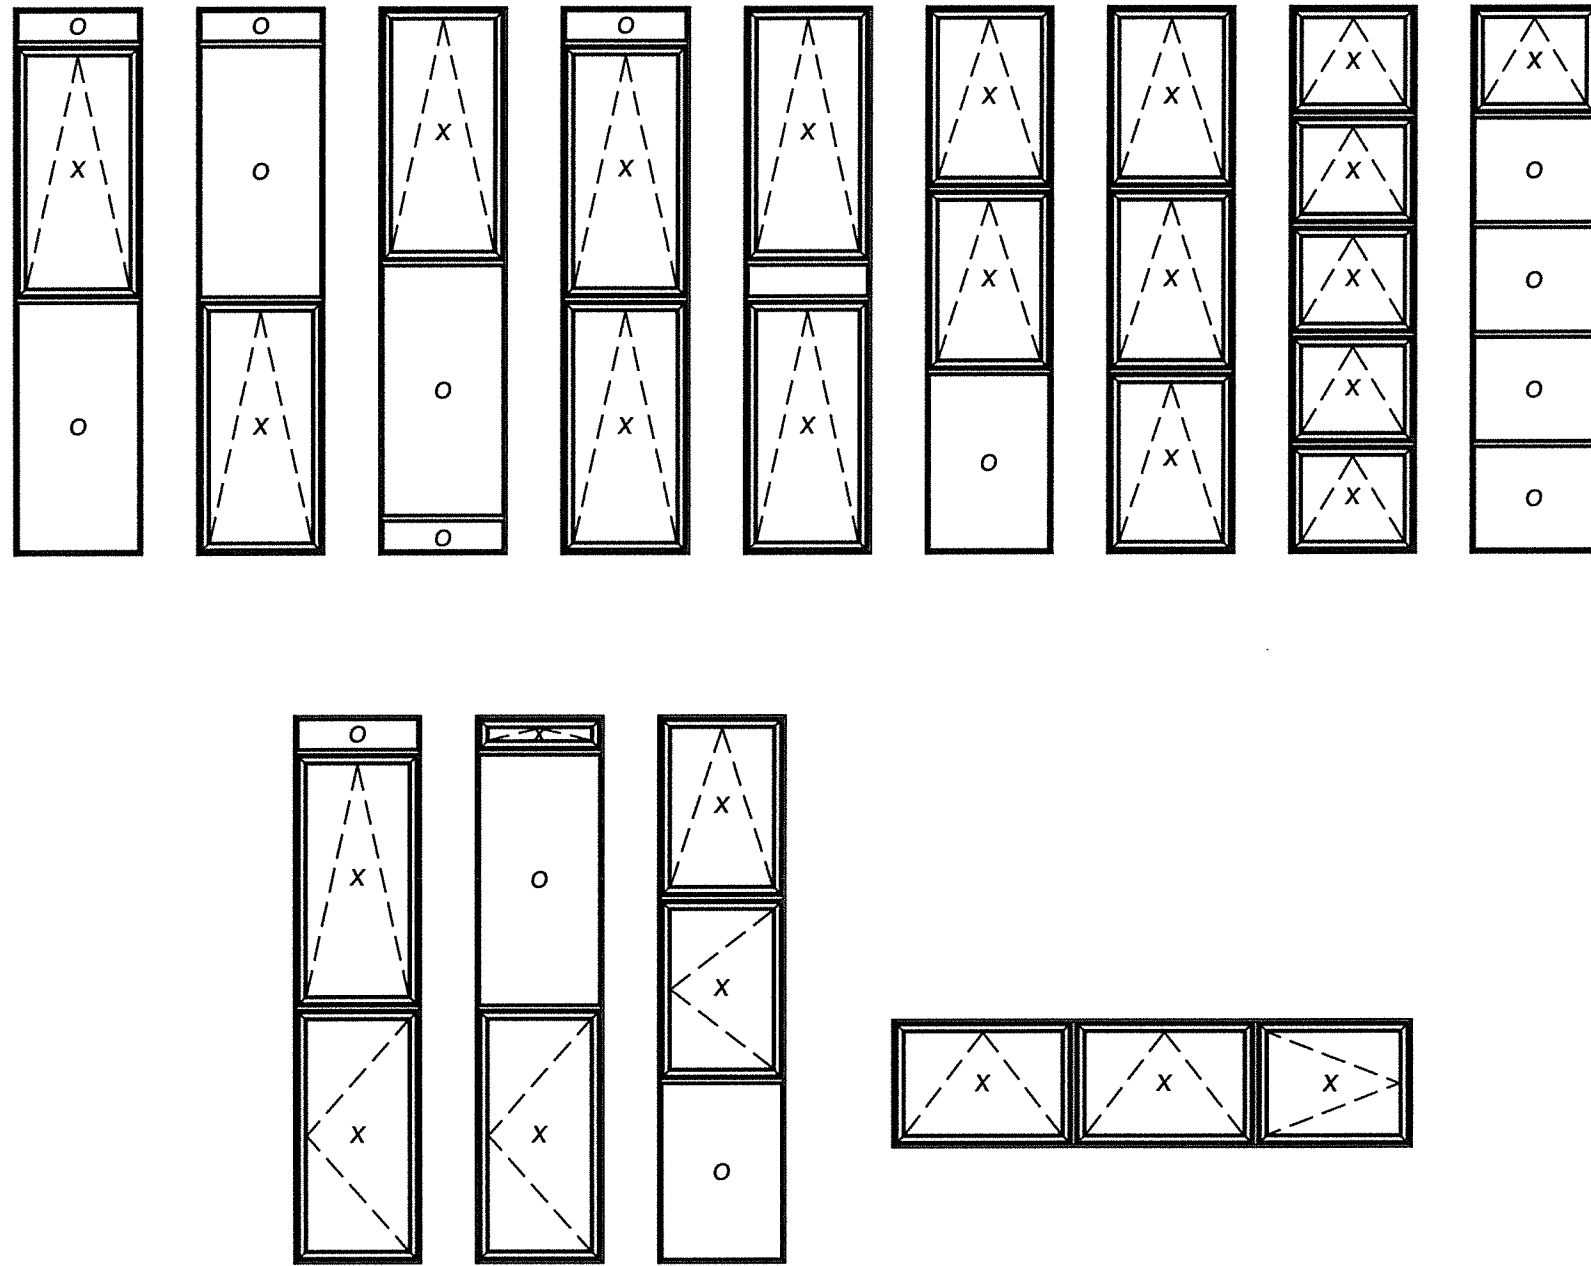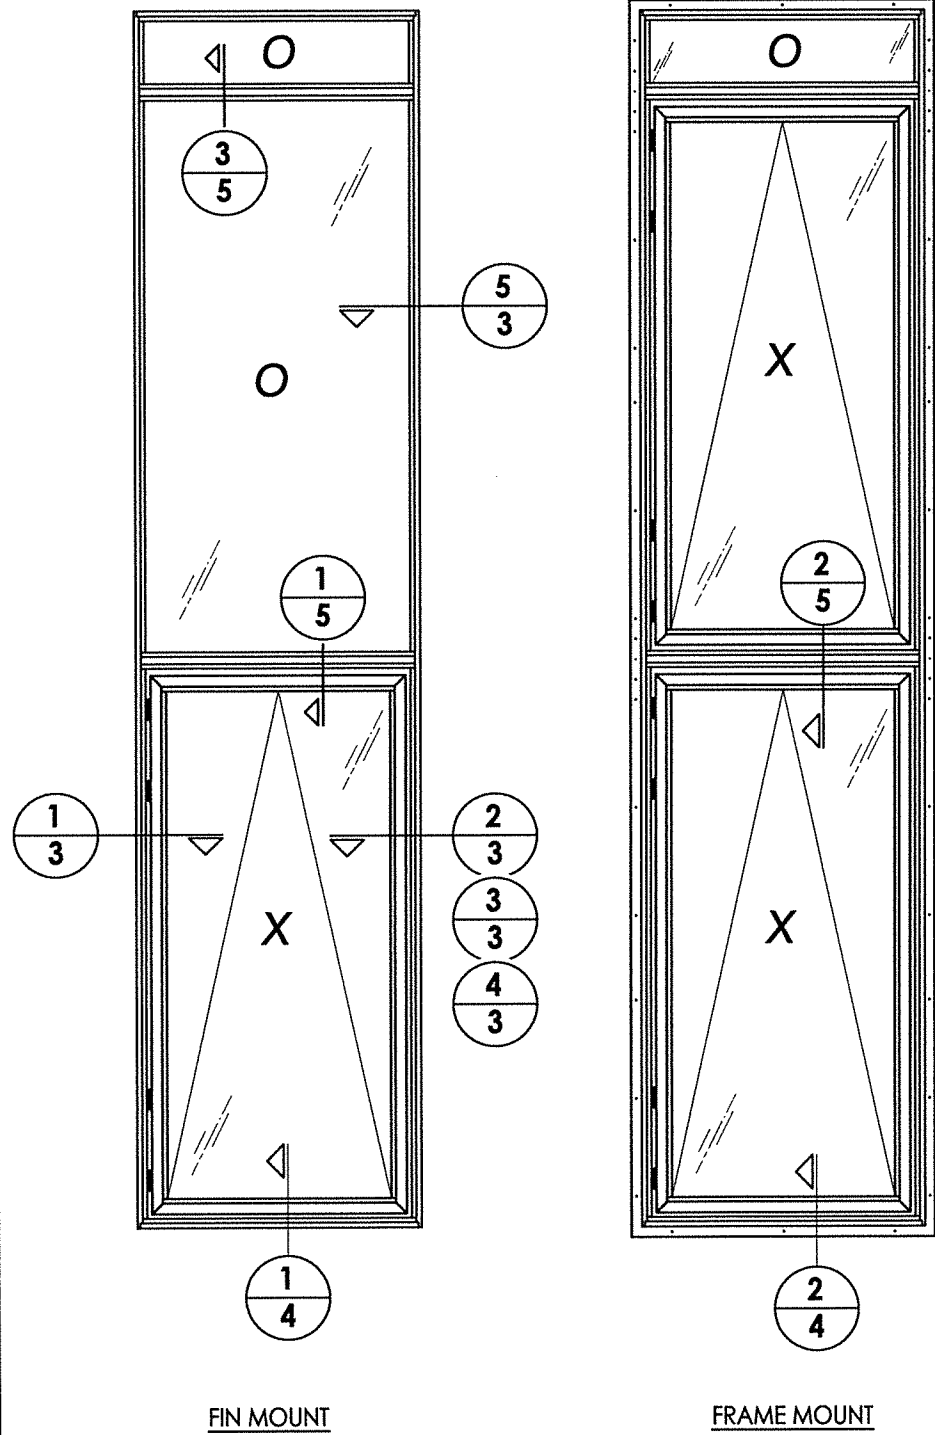

OPTIONAL CONFIGURATIONS

NOTE: Any combination of awning, casement or fixed windows configurations are allowed. Do not exceed the maximum frame size or daylight openings as shown in this approval or with the separate corresponding casement approval.

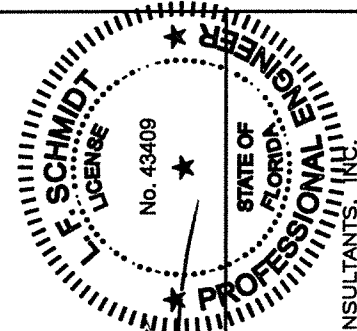


December 8, 2021
 Documents Prepared By:
 Lyndon F. Schmidt
 P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
 P.O. Box 230, Valrico, FL 33595
 Phone No.: 813.659.9197
 FBPE Registry No. 9813


PRODUCT:		FLEETWOOD WINDOWS & DOORS	
PART OR ASSEMBLY:		ELEVATIONS	
NO.	DATE	REVISIONS	BY
4	12/08/21	SERIES NAME CHANGE	LFS
3	8/10/20	UPDATE TO 7th ED. (2020) FBC	DAC
2	8/07/17	UPDATE TO 6TH ED. (2017) FBC	LFS
1	8/22/16	RENUMBER DRAWINGS	JK

DATE: 6/27/16
 SCALE: N.T.S.
 DWG. BY: JK
 CHK. BY: LFS
 DRAWING NO.: FL-14907.4
 SHEET 2 OF 9

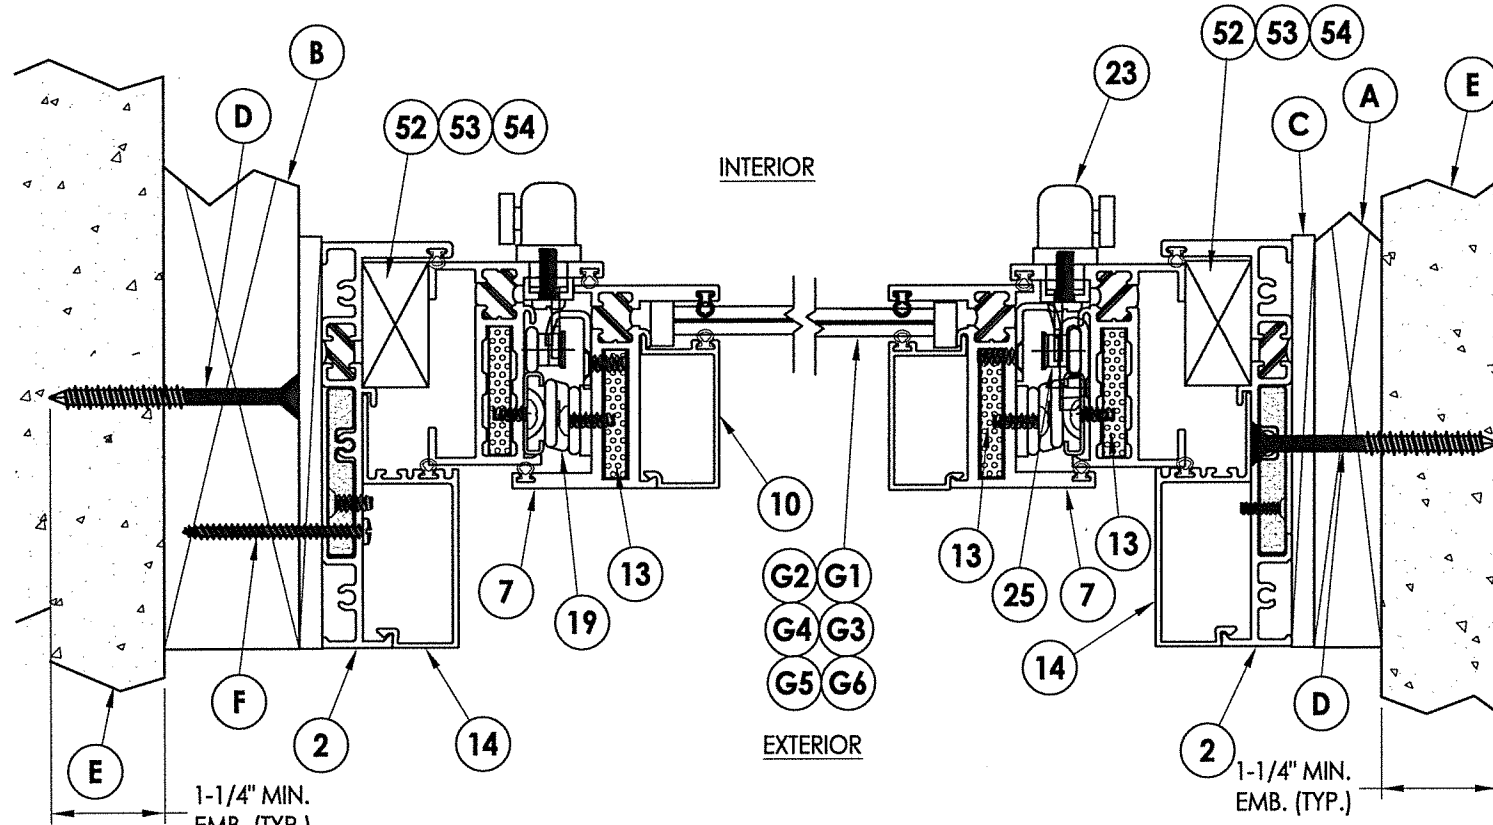


1 HORIZONTAL CROSS SECTION
3 Shown w/ 2X Buck Construction


2 HORIZONTAL CROSS SECTION
3 Shown w/ 1X Sub buck option

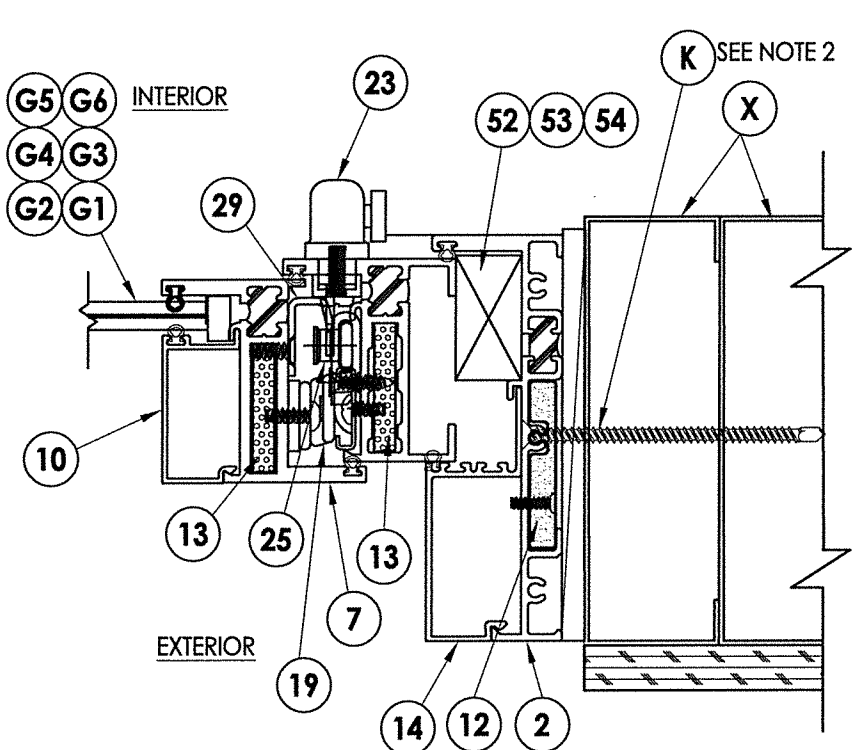

3 HORIZONTAL CROSS SECTION
3 Shown w/ Steel Stud option

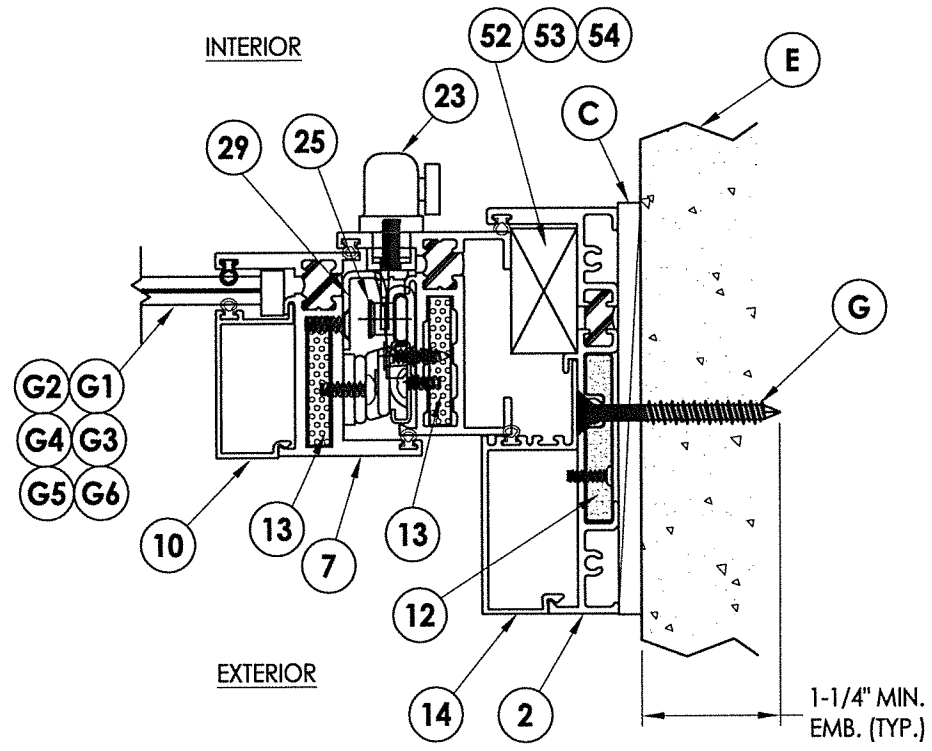


4 HORIZONTAL CROSS SECTION
3 Shown w/ Direct to Masonry option

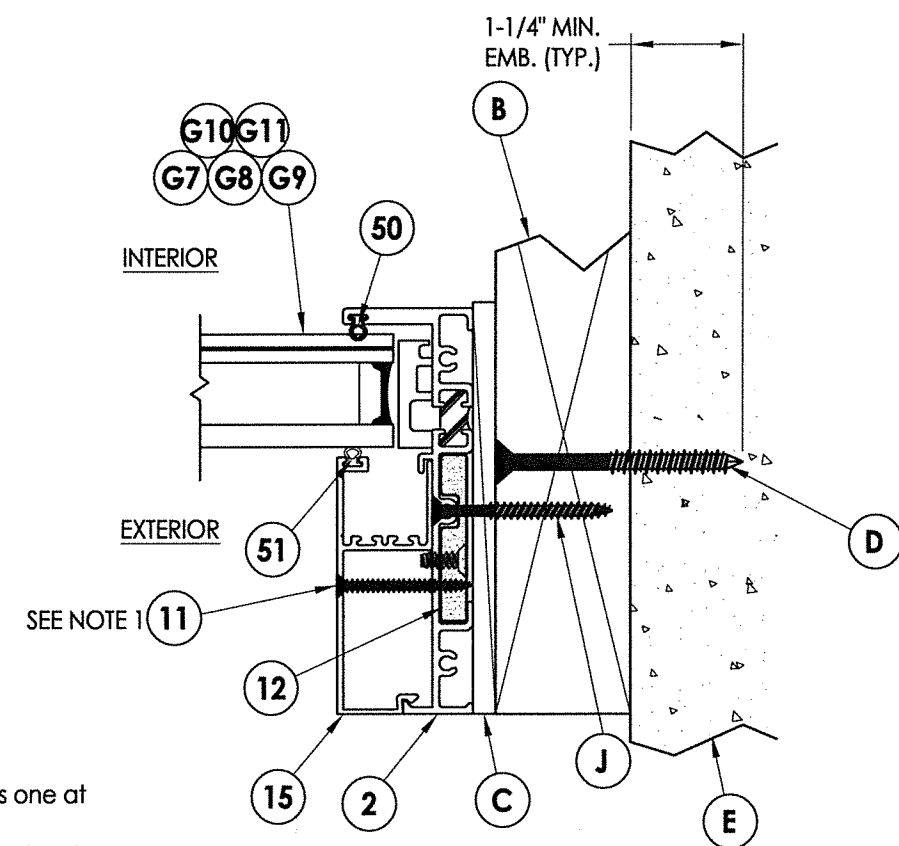

5 HORIZONTAL CROSS SECTION
3 Shown w/ 2X Buck option

NOTES:
 1. Item #11 located 6" from each end plus one at center along jambs (3 total).
 2. Sheet Metal Screws must penetrate a min. of 3 threads through at least two (2) sheets of metal. Maintain a minimum 1/2" edge distance.

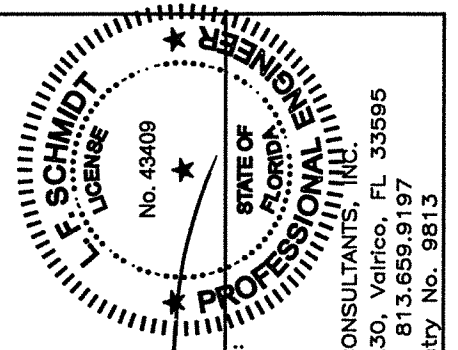


December 8, 2021
 Documents Prepared By:
 Lyndon F. Schmidt
 P.E. No. 43409
 R.W. BUILDING CONSULTANTS, INC.
 P.O. Box 230, Vairico, FL 33595
 Phone No.: 813.659.9197
 FBPE Registry No. 9813


PRODUCT:	FLEETWOOD WINDOWS & DOORS
PART OR ASSEMBLY:	HORIZONTAL CROSS SECTIONS

	LFS	JK	BY
4	12/08/21	SERIES NAME CHANGE	
3	8/10/20	UPDATE TO 7th ED. (2020)	FBC DAC
2	8/07/17	UPDATE TO 6TH ED. (2017)	FBC LFS
1	8/22/16	RENUMBER DRAWINGS	
	NO.	DATE	


DATE:	6/27/16
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-14907.4
SHEET	3 OF 9

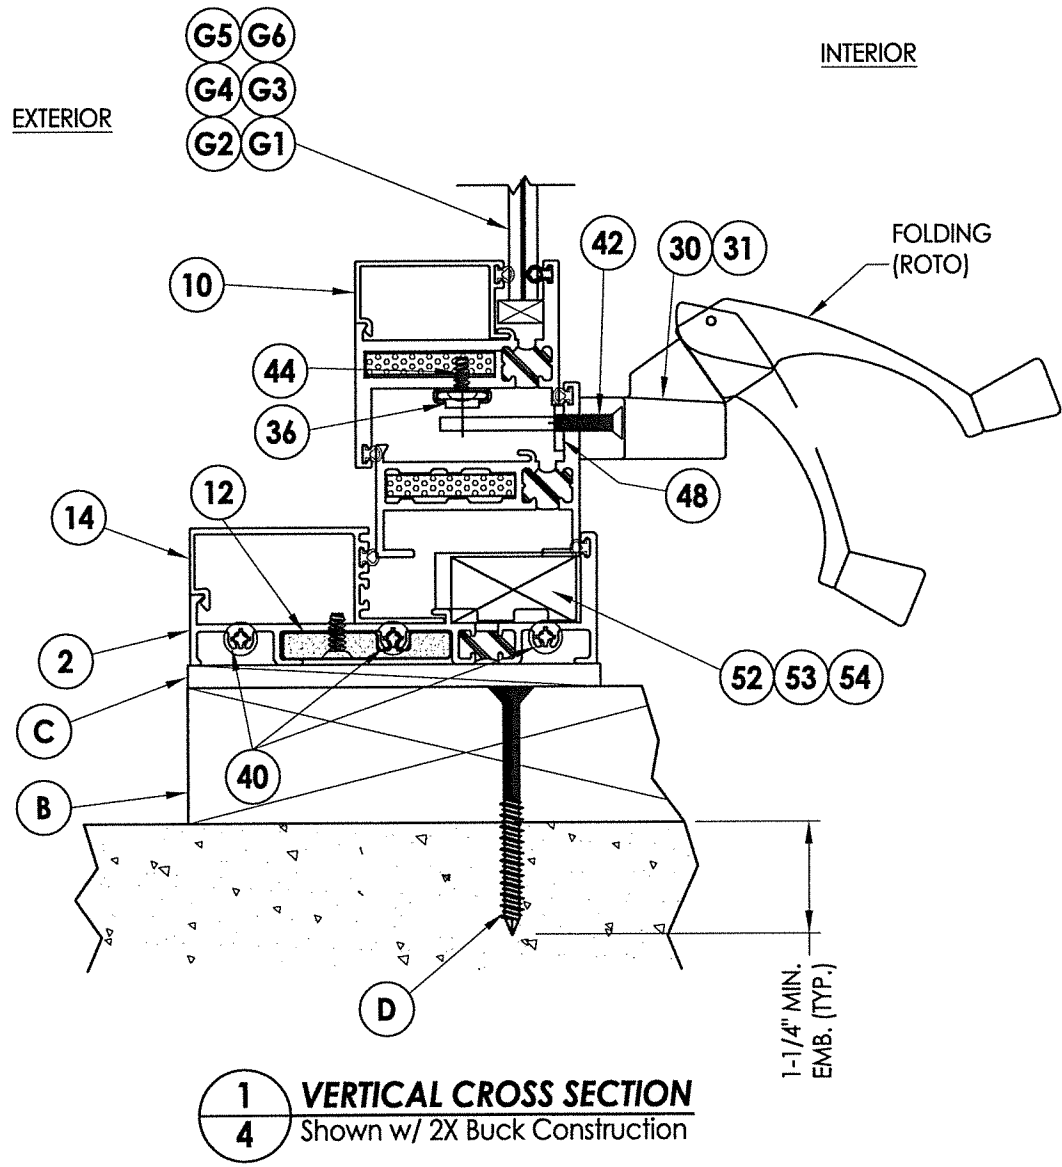

1 VERTICAL CROSS SECTION
4 Shown w/ 2X Buck Construction

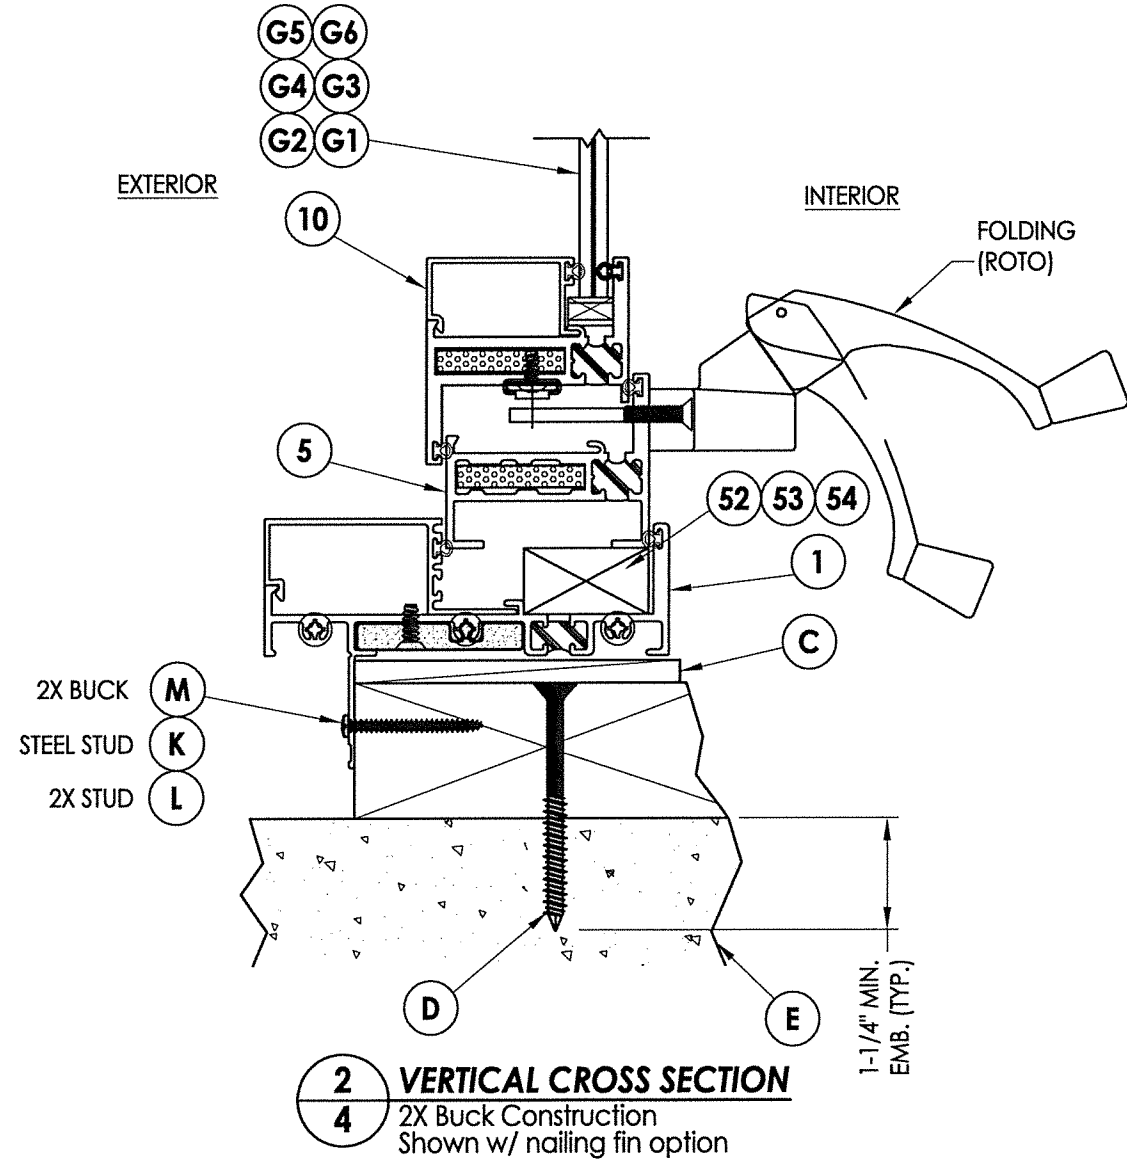


2 VERTICAL CROSS SECTION
4 2X Buck Construction
 Shown w/ nailing fin option

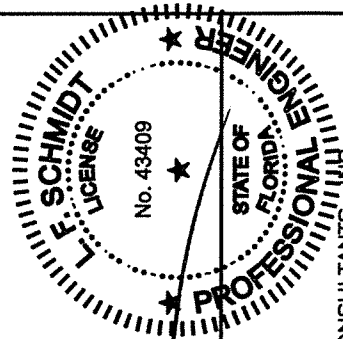


December 8, 2021
 Documents Prepared By:
 Lyndon F. Schmidt
 P.E. No. 43409
 BUILDING CONSULTANTS, INC.
 P.O. Box 230, Valrico, FL 33595
 Phone No.: 813.659.9197
 FBPE Registry No. 9813


PRODUCT:		FLEETWOOD WINDOWS & DOORS	
4	12/08/21	SERIES NAME CHANGE	LFS
3	8/10/20	UPDATE TO 7th ED. (2020)	DAC
2	8/07/17	UPDATE TO 6TH ED. (2017)	FBC
1	8/22/16	RENUMBER DRAWINGS	JK
NO	DATE		BY
DATE:		6/27/16	
SCALE:		N.T.S.	
DWG. BY:		JK	
CHK. BY:		LFS	
DRAWING NO.:		FL-14907.4	
SHEET		4 OF 9	

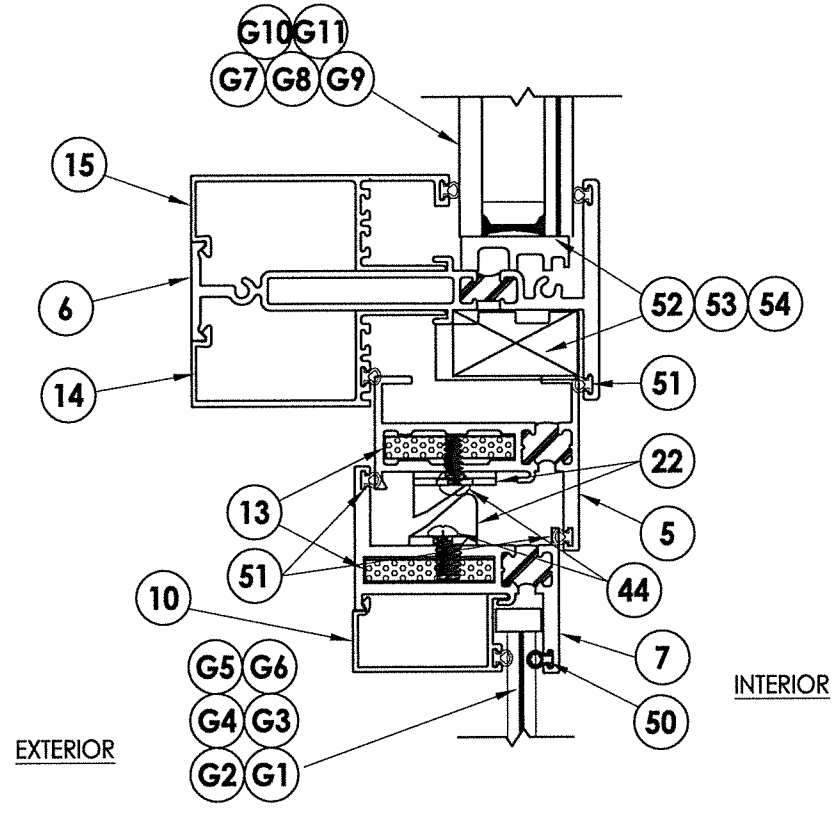


1 HORIZONTAL CROSS SECTION
5

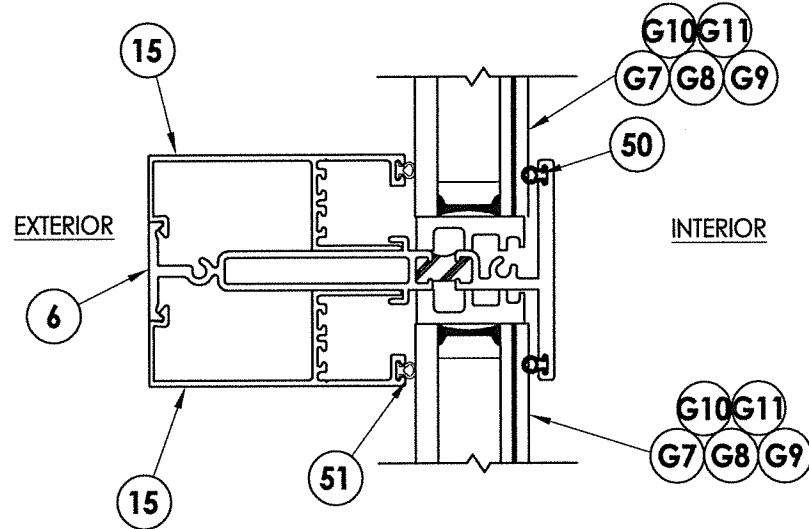

3 HORIZONTAL CROSS SECTION
5



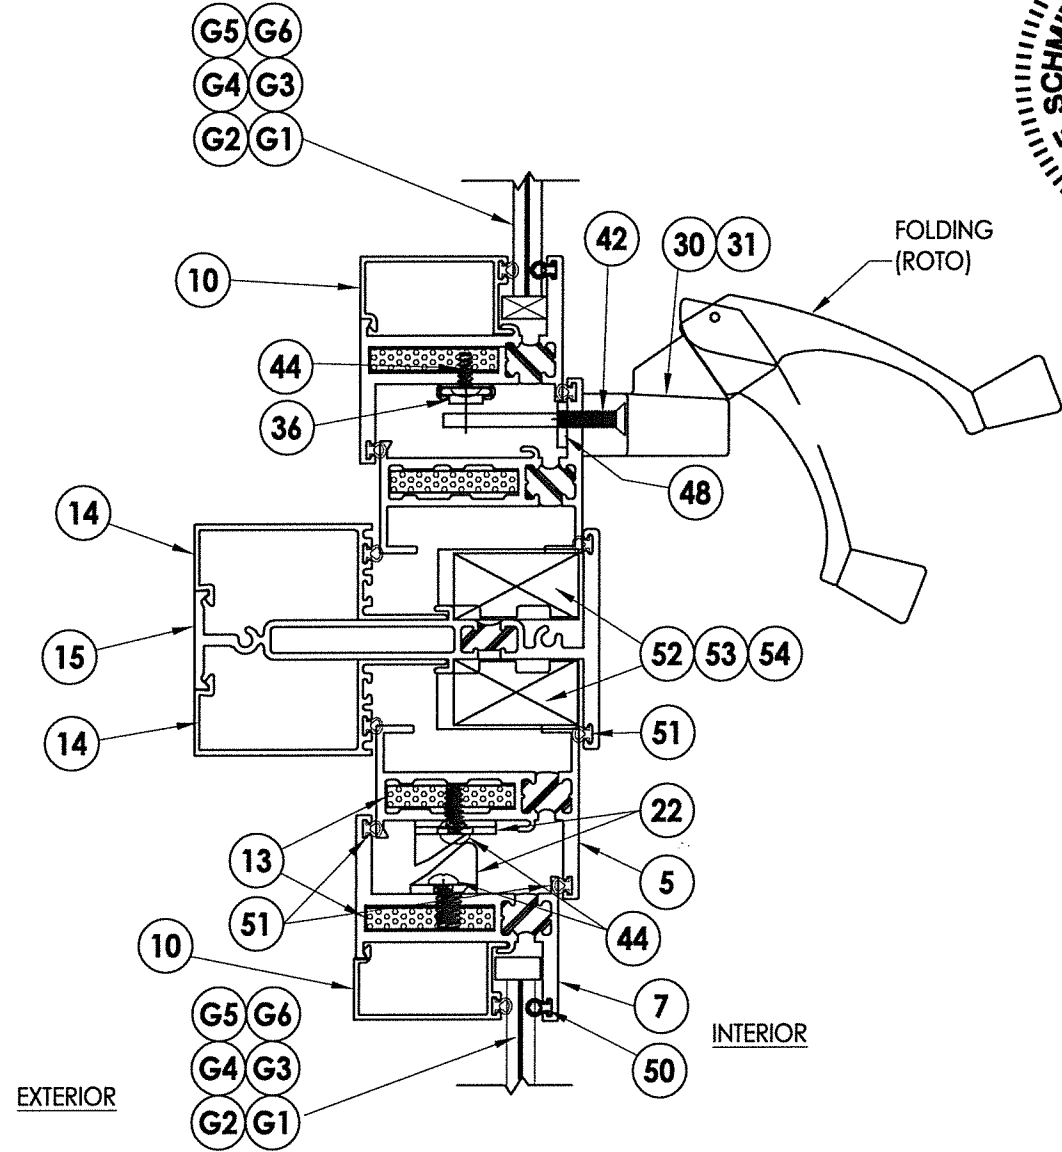


2 HORIZONTAL CROSS SECTION
5

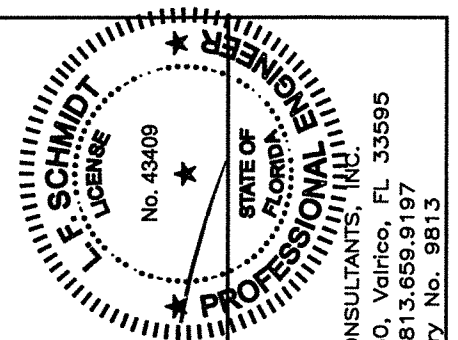

December 8, 2021
 Documents Prepared By:
 Lyndon F. Schmidt
 P.E. No. 4-3409
LFS
 R.W. BUILDING CONSULTANTS, INC.
 P.O. Box 230, Valrico, FL 33595
 Phone No.: 813.659.9197
 FBPE Registry No. 9813

PRODUCT:		FLEETWOOD WINDOWS & DOORS	
NO.	DATE	JK	BY
4	12/08/21	SERIES NAME CHANGE	LFS
3	8/10/20	UPDATE TO 7th ED. (2020)	FBC DAC
2	8/07/17	UPDATE TO 6TH ED. (2017)	FBC LFS
1	8/22/16	RENUMBER DRAWINGS	JK
DATE: 6/27/16		SCALE: N.T.S.	
DWG. BY: JK		CHK. BY: LFS	
DRAWING NO.: FL-14907.4		SHEET 5 OF 9	

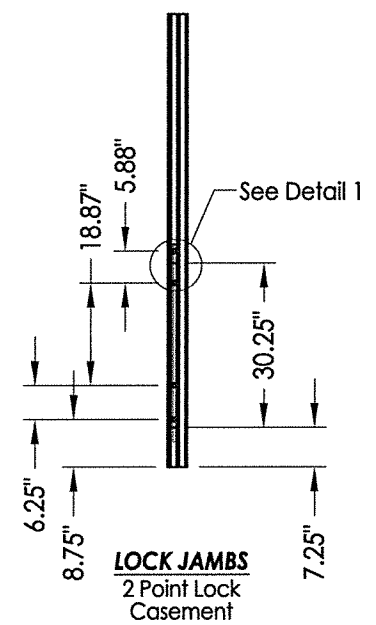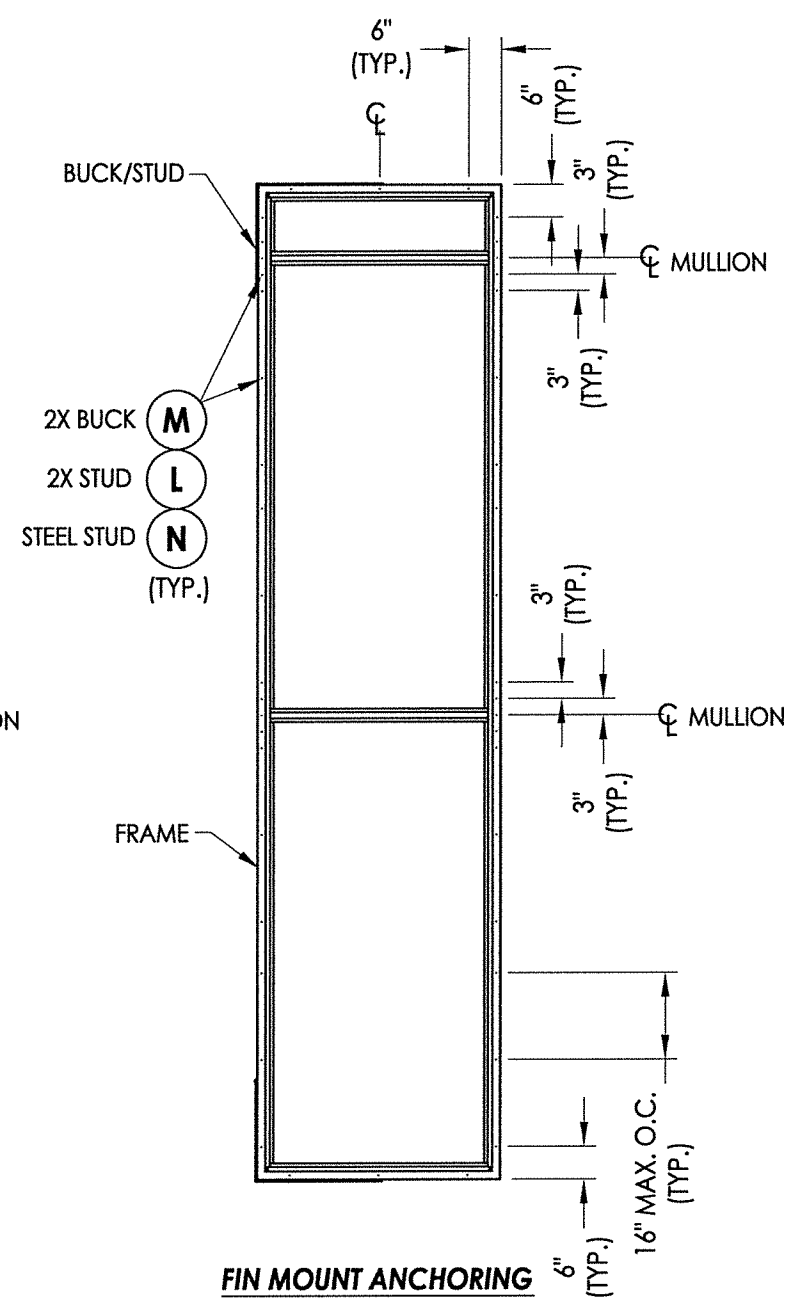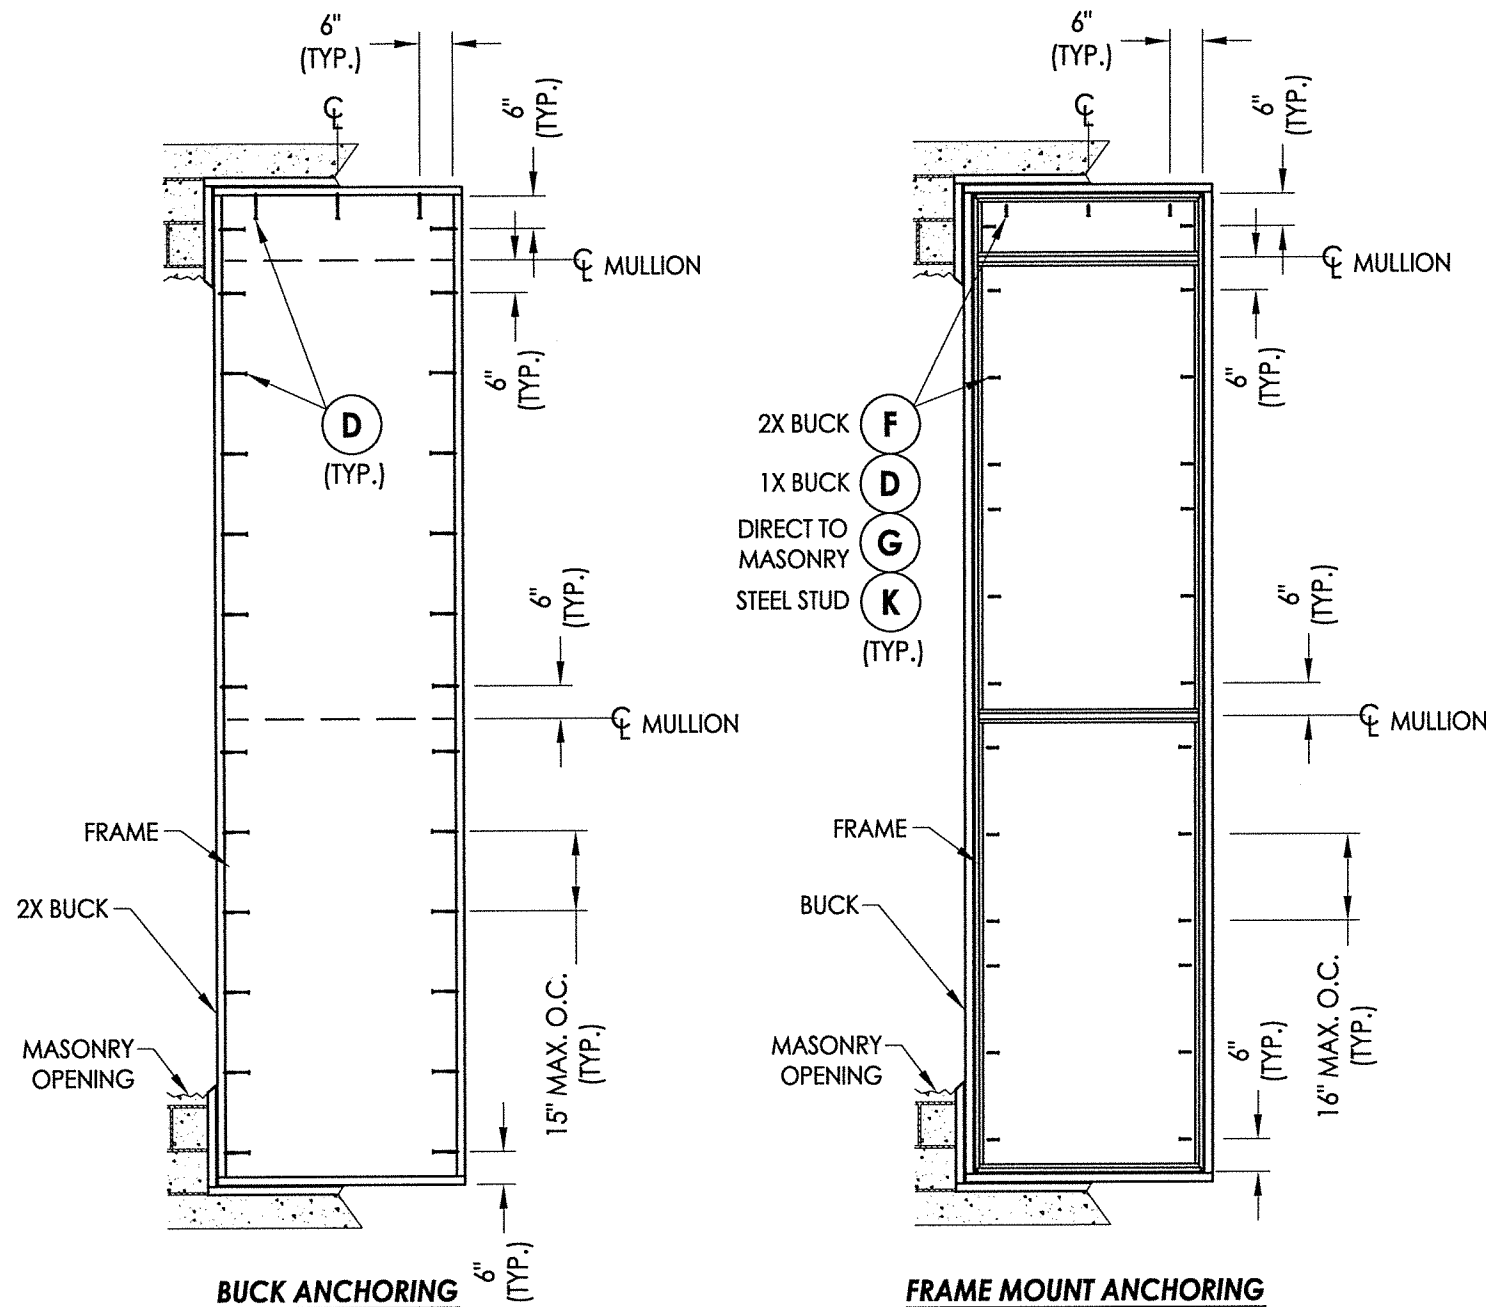


CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:


ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
ITW TAPCON®	1/4"	1-1/4"	2"	4"
DeWALT ULTRACON®	1/4"	1-1/4"	1"	4"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

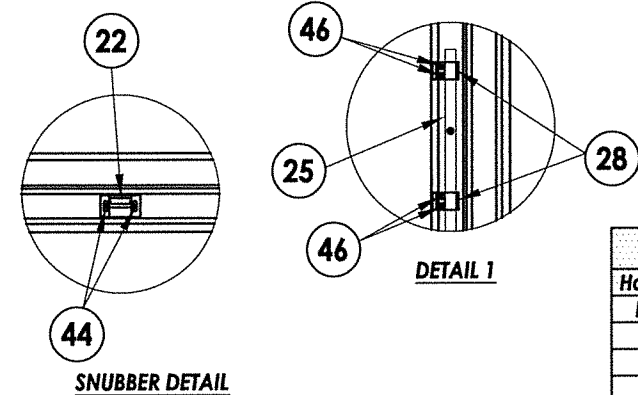

Handles	Points	Description	Height	*Cam locks can be used in conjunction with multipoint lock or in lieu of multipoint locks
2	Multipoint	> 50"		
1	Multipoint	≤ 50"		
Qty.				
2	Cam*	≤ 50"		

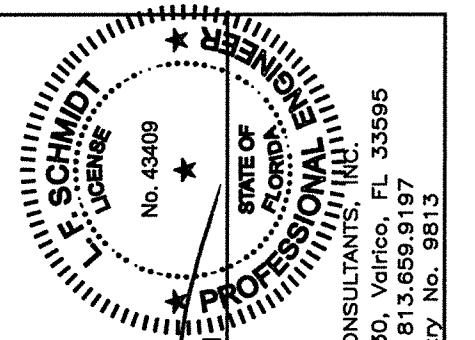


December 8, 2021
 Documents Prepared By:
 Lyndon F. Schmidt
 P.E. No. 43409
 R.W. BUILDING CONSULTANTS, INC.
 P.O. Box 230, Valrico, FL 33595
 Phone No.: 813.659.9197
 FBPE Registry No. 9813


NO.	DATE	REVISIONS
4	12/08/21	SERIES NAME CHANGE
3	8/10/20	UPDATE TO 7TH ED. (2020) FBC DAC
2	8/07/17	UPDATE TO 6TH ED. (2017) FBC DAC
1	8/22/16	RENUMBER DRAWINGS

PRODUCT: FLEETWOOD WINDOWS & DOORS
 PART OR ASSEMBLY: BUCK & FRAME ANCHORING


DATE: 6/27/16
 SCALE: N.T.S.
 DWG. BY: JK
 CHK. BY: LFS
 DRAWING NO.: FL-14907.4
 SHEET 6 OF 9

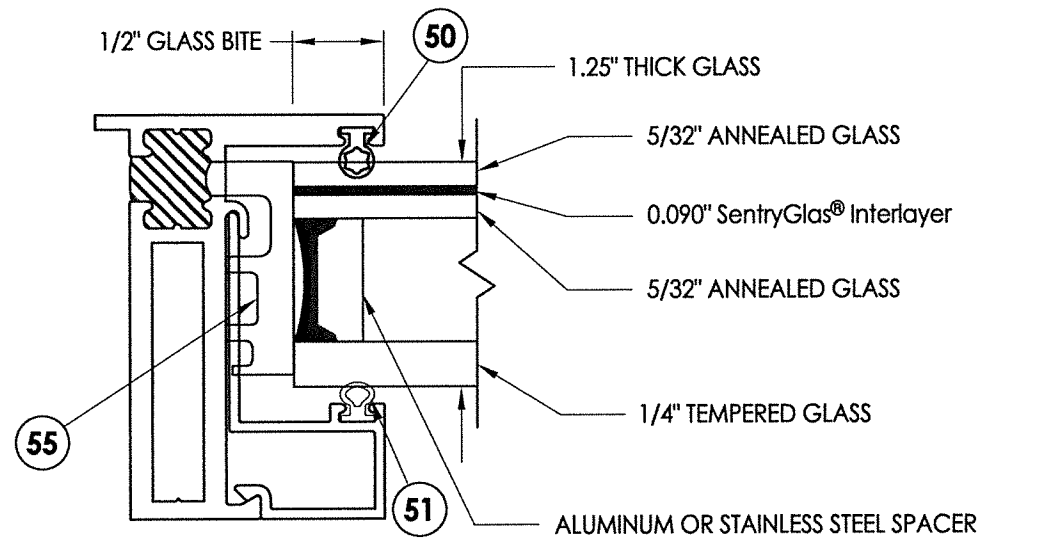


G1 GLAZING DETAIL

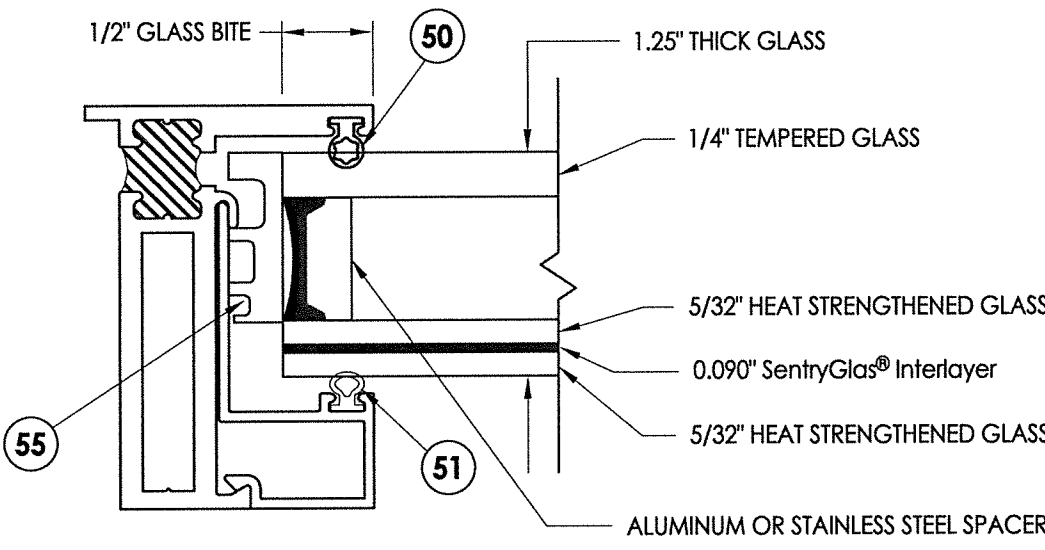


G2 GLAZING DETAIL

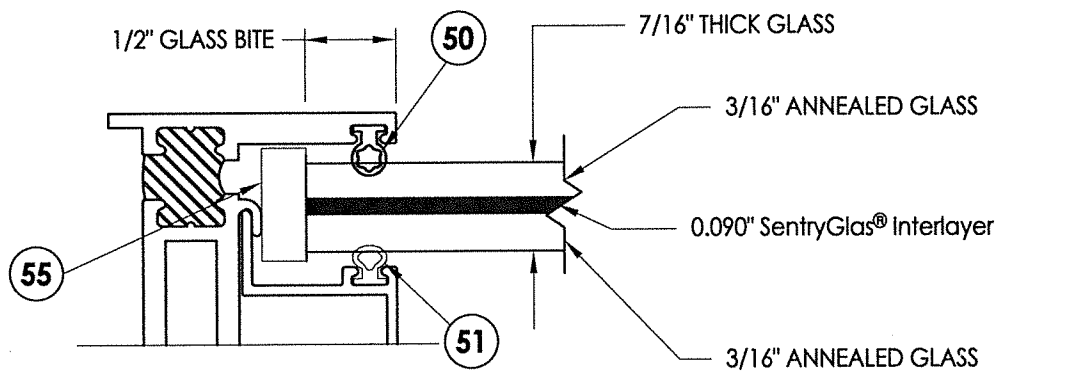


G3 GLAZING DETAIL

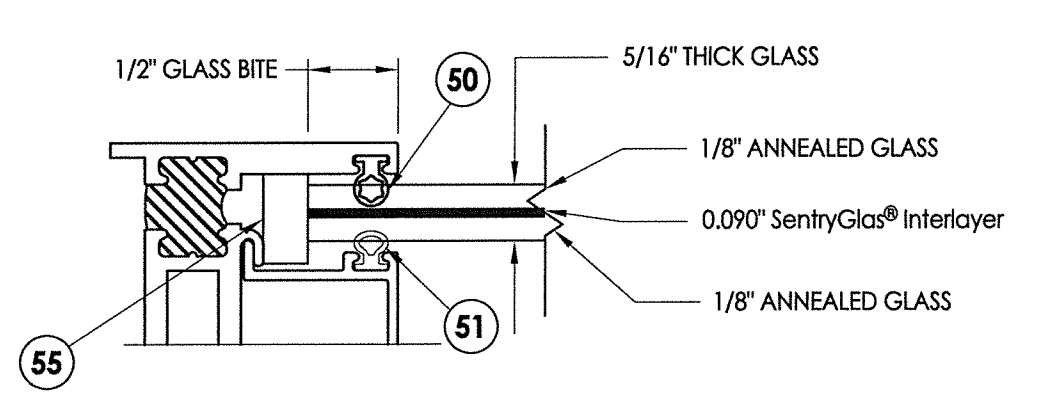

G4 GLAZING DETAIL

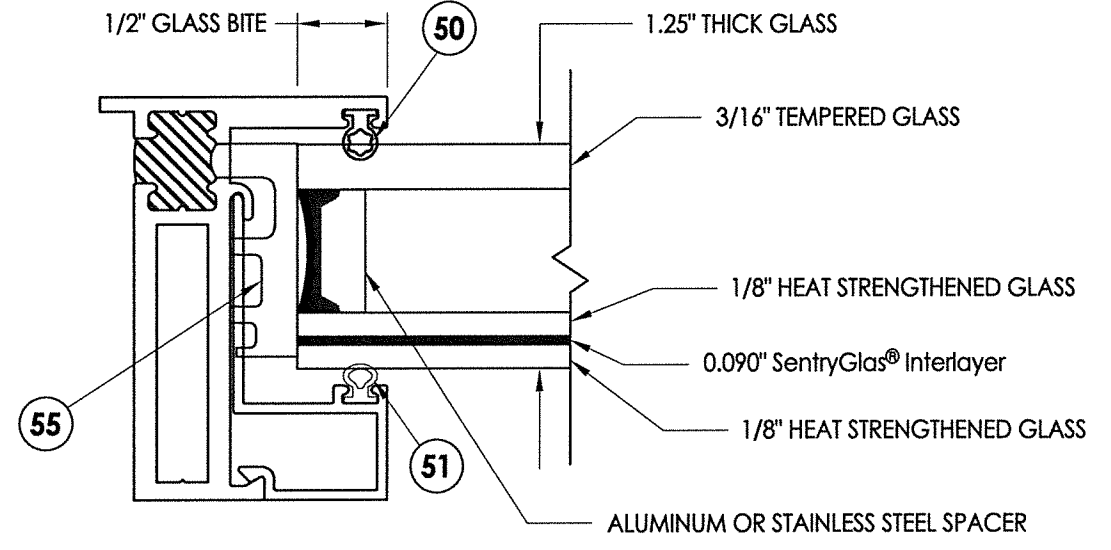

G5 GLAZING DETAIL


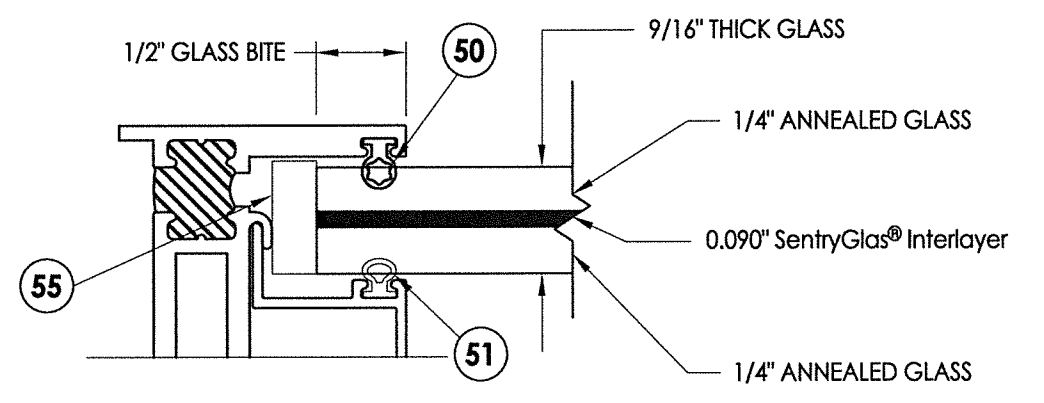


G6 GLAZING DETAIL





December 8, 2021
 Documents Prepared By:
 Lyndon F. Schmidt
 P.E. No. 4-3409

RW
 BUILDING CONSULTANTS, INC.
 P.O. Box 230, Valrico, FL 33595
 Phone No.: 813.659.9197
 FBPE Registry No. 9813

PRODUCT:		FLEETWOOD WINDOWS & DOORS			
4	12/08/21	SERIES NAME CHANGE	LFS		
3	8/10/20	UPDATE TO 7th ED. (2020)	FBC	DAC	
2	8/07/17	UPDATE TO 6TH ED. (2017)	FBC	LFS	
1	8/22/16	RENUMBER DRAWINGS	JK		
	NO.	DATE			REVISIONS
DATE:		6/27/16			
SCALE:		N.T.S.			
DWG. BY:		JK			
CHK. BY:		LFS			
DRAWING NO.:		FL-14907.4			
SHEET		7 OF 9			

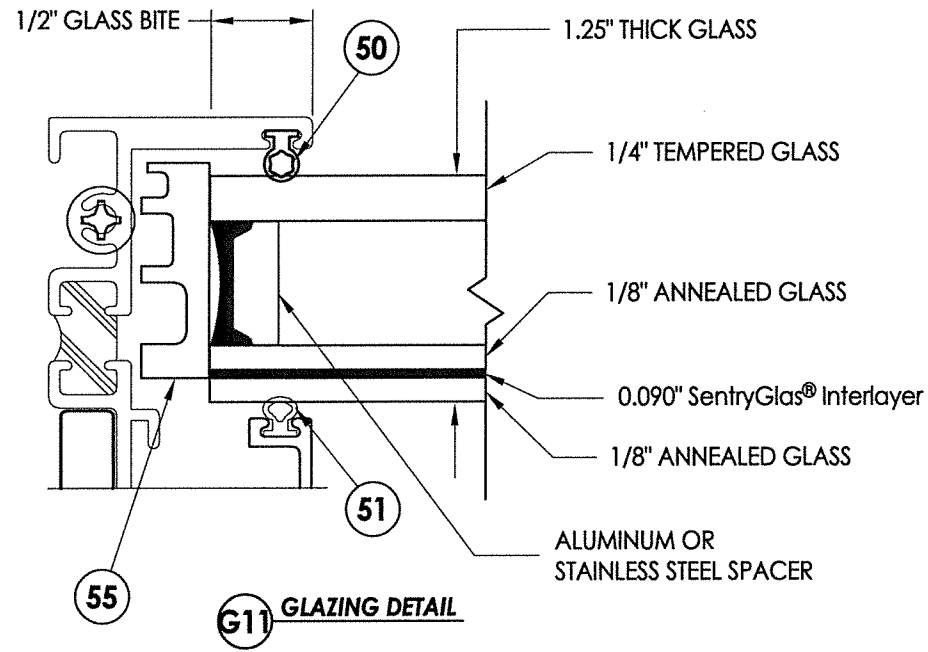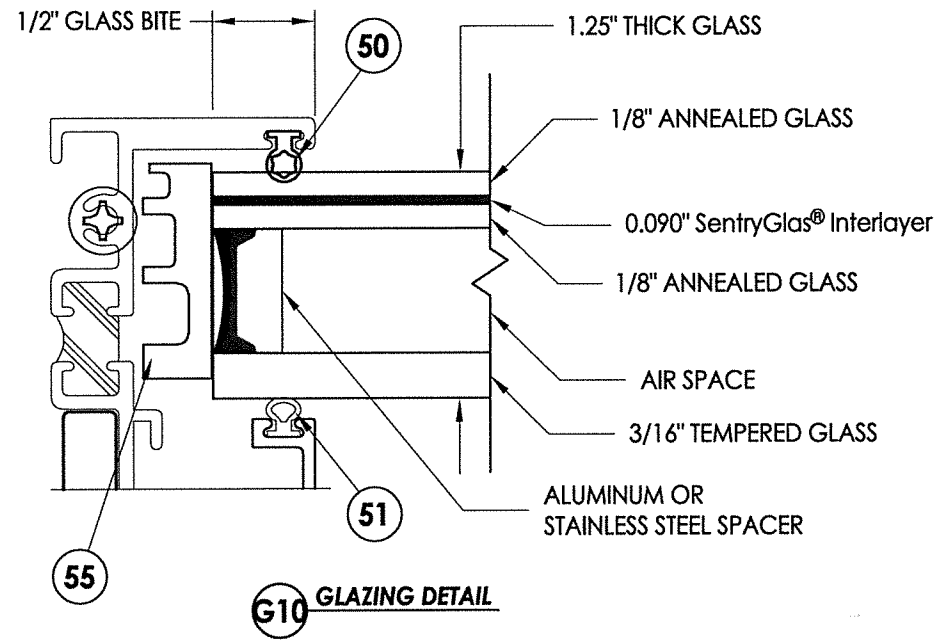



NOTE: GLAZING > 36" WIDE REQUIRES AT LEAST TWO (2) SETTING BLOCKS CONFORMING TO FBC SECTION 2411.3.3.1.

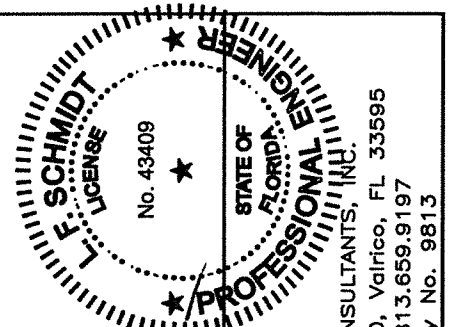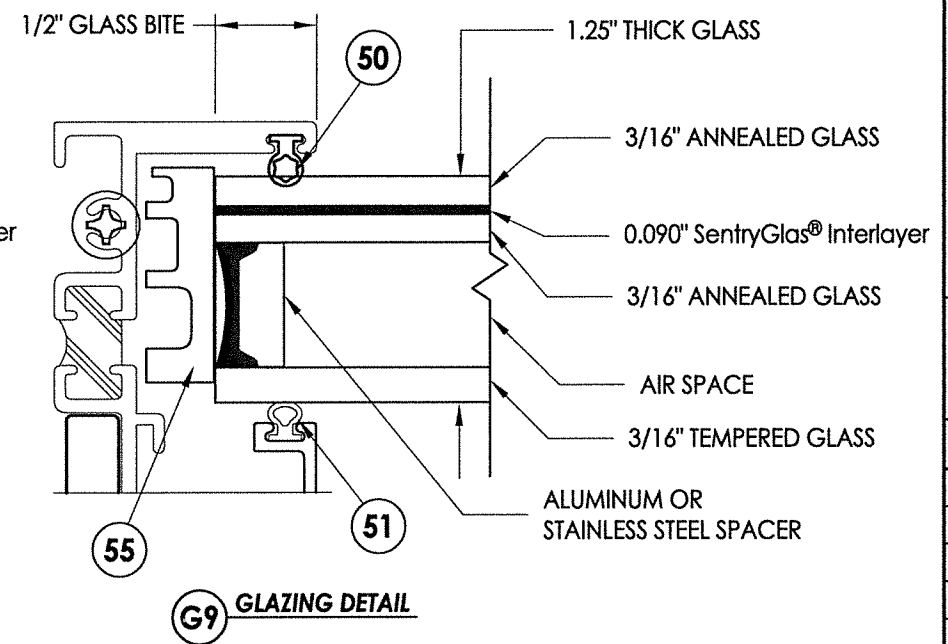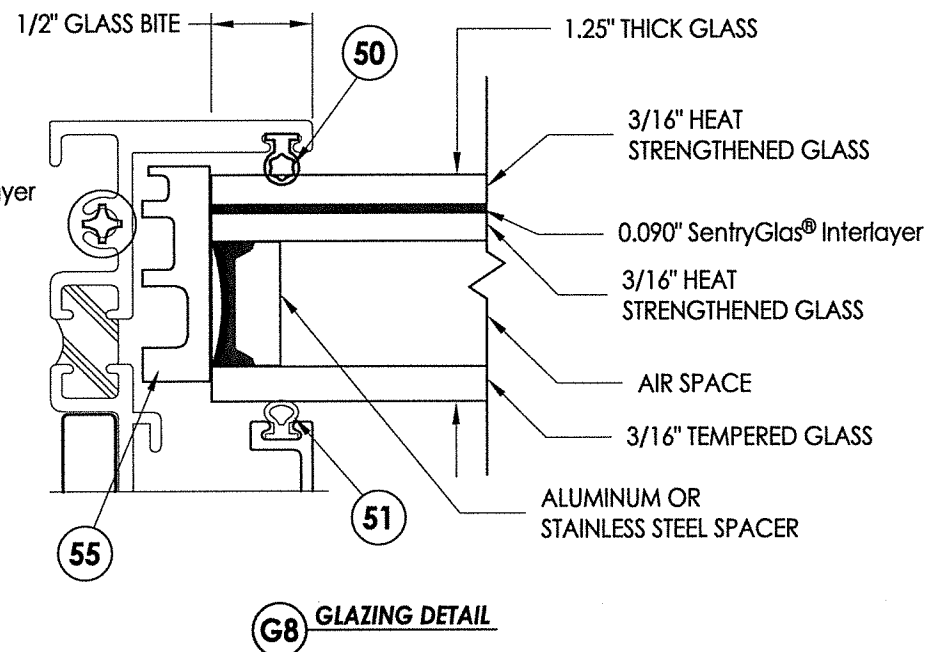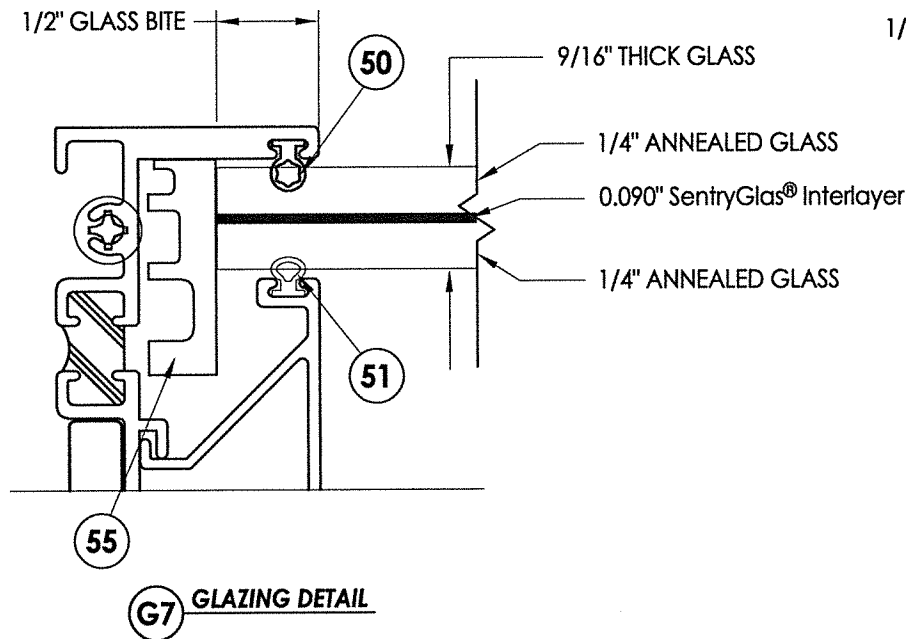

December 8, 2021
 Documents Prepared By:
 Lyndon F. Schmidt
 P.E. No. 43409
 R.W. BUILDING CONSULTANTS, INC.
 P.O. Box 230, Valrico, FL 33595
 Phone No.: 813.659.9197
 FBPE Registry No. 9813

PRODUCT:		FLEETWOOD WINDOWS & DOORS	
PART OR ASSEMBLY:		GLAZING DETAILS (FIXED)	
DATE	NO.	BY	REVISIONS
12/08/21	4	LFS	NAME CHANGE
8/10/20	3	DAC	UPDATE TO 7th ED. (2020) FBC
8/07/17	2	FBC	UPDATE TO 6TH ED. (2017) FBC
8/22/16	1	JK	RENUMBER DRAWINGS
DATE: 6/27/16			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-14907.4			
SHEET 8 OF 9			

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK SG >= 0.55	WOOD
B	2X BUCK SG >= 0.55	WOOD
C	1/4" MAX. SHIM SPACE	-
D	1/4" X 2-3/4" DeWALT OR ITW PFH CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	#10 X 2" PPH WOOD SCREW (1-1/4" MIN. EMBEDMENT)	STEEL
G	1/4" x 2-1/4" DeWALT OR ITW PFH CONCRETE SCREW	STEEL
J	#10 X 2" PFH WOOD SCREW (1-1/4" MIN. EMBEDMENT)	STEEL
K	#10 PPH SELF-DRILLING SMS	STEEL
L	#8 PPH SMS (1-3/8" MIN. EMBEDMENT)	STEEL
M	#8 x 1-1/2" PPH SMS (1-3/8" MIN. EMBEDMENT)	STEEL
X	STEEL STUD Min. Thk .033" (ASTM A653 GRADE 33 Fy=33 Ksi Min, Fu=45 Ksi Min)	STEEL
1	FIN BLOCK FRAME (3800-T)	6063-T6 ALUM
2	BLOCK FRAME (3800-T)	6063-T6 ALUM
3	THERMAL BREAK ("LIQUID POLYURETHANE" by Azon USA, Inc.)	-
5	BLOCK FRAME (350-T)	6063-T6 ALUM
6	MULLION	6063-T6 ALUM
7	ZEE BAR (PANEL)	6063-T6 ALUM
8	GLASS STOP (1-1/4") OPERABLE PANEL	6063-T6 ALUM
10	GLASS STOP (5/16", 7/16", 9/16") OPERABLE PANEL	6063-T6 ALUM
11	#8 x 1-1/2" PFH SMS	STEEL
12	SHEAR BLOCK	6061-T6 ALUM
13	CORNER KEY	6063-T6 ALUM
14	INSERT STOP	6063-T6 ALUM
15	GLASS STOP (1-1/4") FIXED PANEL	6063-T6 ALUM
16	GLASS STOP (9/16") FIXED PANEL	6063-T6 ALUM
19	2 BAR HINGE	SS
21	4 BAR HINGE	SS
22	SNUBBER-COMMERCIAL PULL-IN BLOCK	SS
23	MULTIPOINT LOCK HANDLE	SS
24	1 POINT LOCKING BAR (TRUTH)	SS
25	2 POINTS LOCKING BAR (TRUTH)	SS
28	TIE BAR GUIDE (TRUTH)	-
29	KEEPER (TRUTH)	SS
30	CASEMENT ROTOR GEAR 13.5" (TRUTH)	SS
31	CASEMENT ROTOR GEAR 9.5" (TRUTH)	SS
35	CAM HANDLE / STRIKE PLATE	SS
36	CASEMENT SS. TRACK (TRUTH)	SS
40	#10 X 1" PPH SMS	STEEL
42	MACHINE SCREW NO 10-32, FHP .75"	STEEL
44	SCREW NO 8, PHP, .50"	STEEL
46	SCREW NO 8, FHP, .750"	STEEL
48	BACK UP NUTS	STEEL
50	BULB VINYL (EPDM 70 DUROMETER)-TREMCO	-
51	MINI BULB VINYL (EPDM 70 DUROMETER)-TREMCO	-
52	WOOD BLOCK .750" X 1.250"	-
53	ALUMINUM BLOCK .750" X 1.250"	-
54	PVC BLOCK .750" X 1.250"	-
55	SETTING BLOCK (SANTOPRENE - 86 DUROMETER) - TREMCO	-

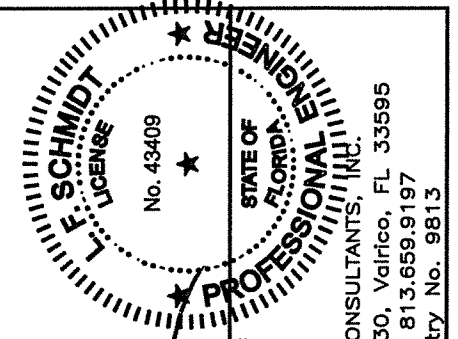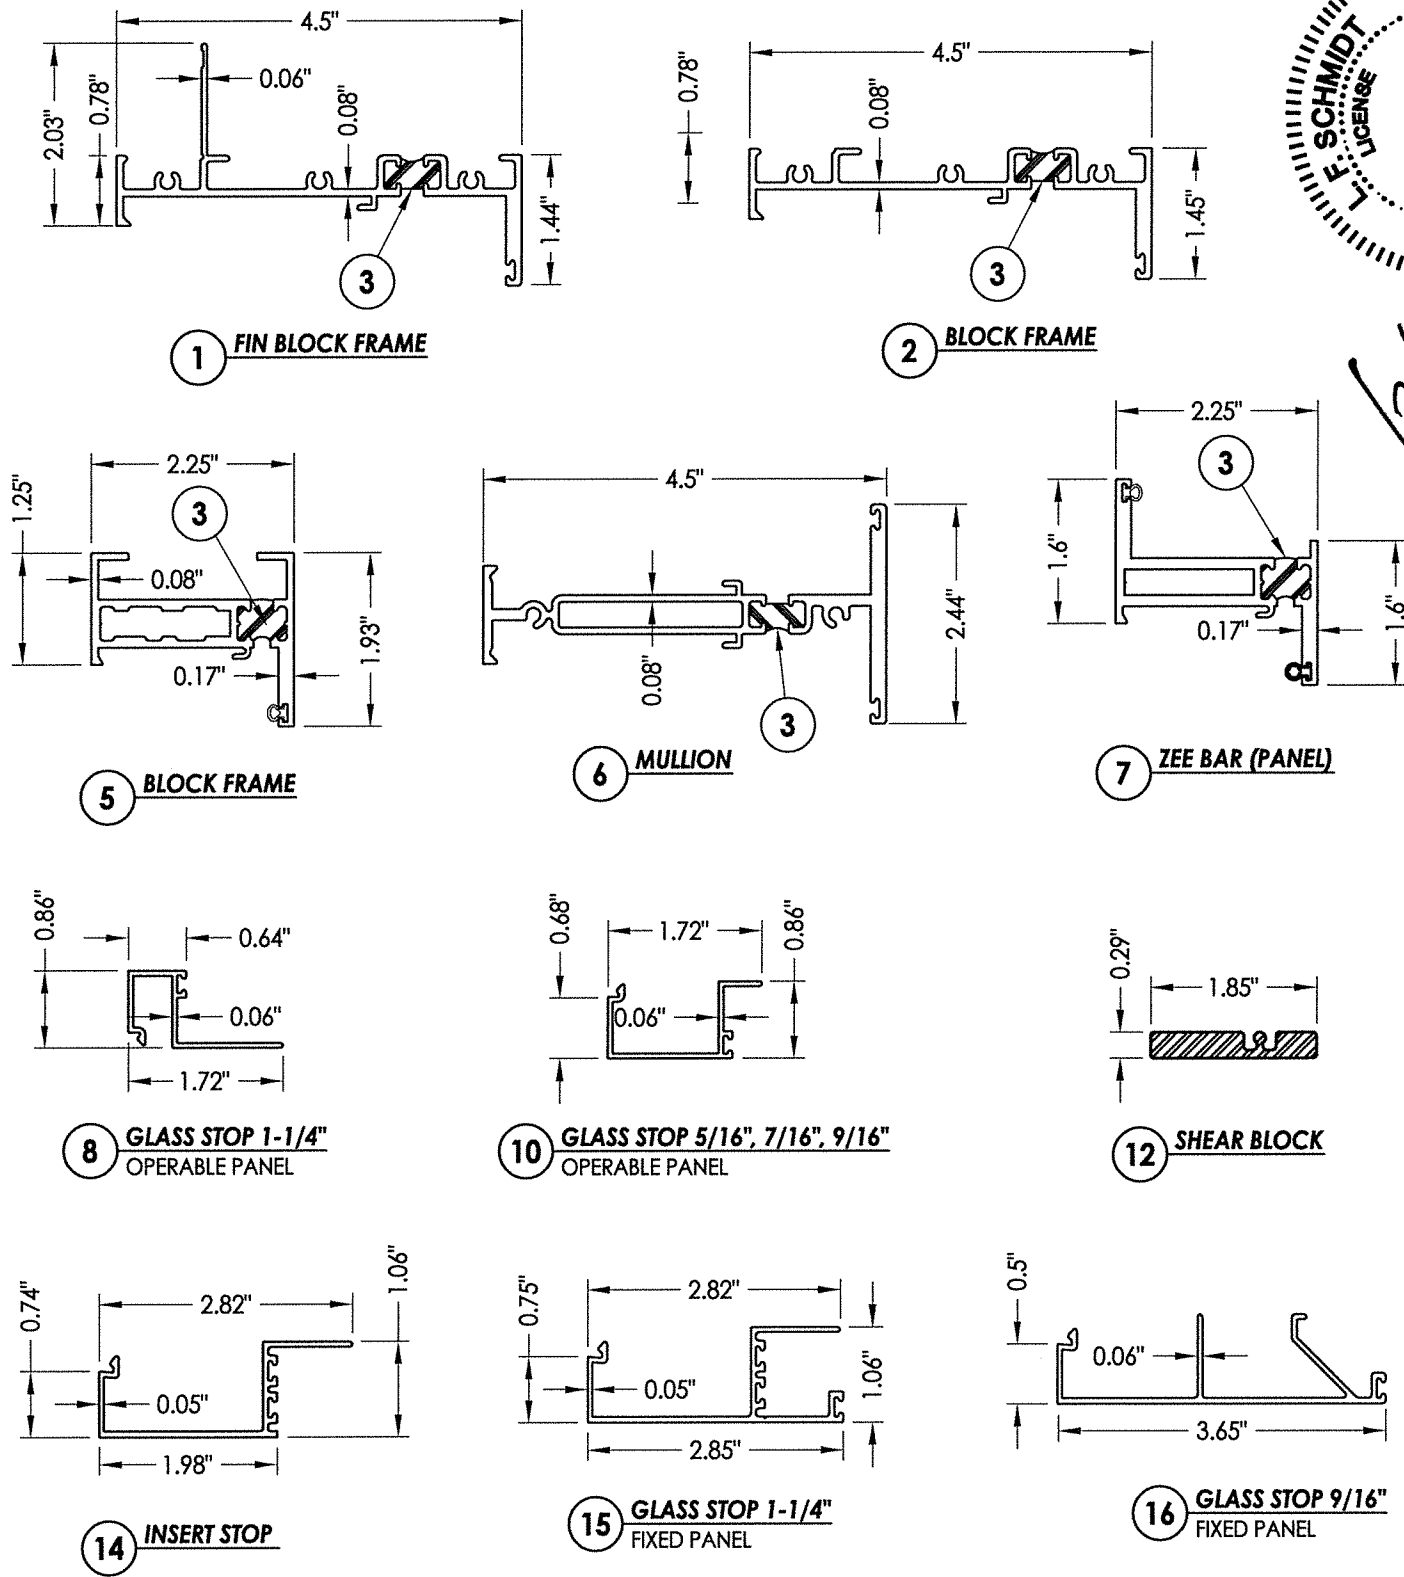

December 8, 2021
 Documents Prepared By:
 Lyndon F. Schmidt
 P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
 P.O. Box 230, Valrico, FL 33595
 Phone No.: 813.659.9197
 FBPE Registry No. 9813

PRODUCT:		FLEETWOOD WINDOWS & DOORS	
PART OR ASSEMBLY:		BILL OF MATERIALS AND COMPONENTS	
NO.	DATE	BY	REVISIONS
4	12/08/21	LFS	SERIES NAME CHANGE
3	8/10/20	DAC	UPDATE TO 7th ED. (2020) FBC
2	8/07/17	LFS	UPDATE TO 6TH ED. (2017) FBC
1	8/22/16	JK	RENUMBER DRAWINGS

DATE: 6/27/16
 SCALE: N.T.S.
 DWG. BY: JK
 CHK. BY: LFS
 DRAWING NO.: FL-14907.4
 SHEET 9 OF 9