


GENERAL NOTES


1. This product has been evaluated and is in compliance with the 7th Edition (2020) Florida Building Code (FBC) structural requirements including the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in the "HVHZ" this product complies with Section 1626 of the Florida Building Code and does not require an impact resistant covering.
4. When used in areas requiring wind borne debris protection this product complies with FBC Sections 1609.1.2 & R301.2.1.2 and does not require an impact resistant covering. This product meets missile level "D" and includes Wind Zone 4 as defined in ASTM E 1996 and FBC Sections 1609.1.2.2 & R301.2.1.2.1.
5. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
6. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.
7. This product meets water infiltration requirements for "HVHZ".
8. Aluminum components, including fasteners, shall meet the requirements of FBC Section 2003.
9. Gaskets shall comply with FBC Section 2411.3.4.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures and general notes
2	Horizontal cross sections
3	Vertical cross sections
4	Buck anchoring
5	Frame anchoring
6	Components
7	Bill of materials, components and glazing details

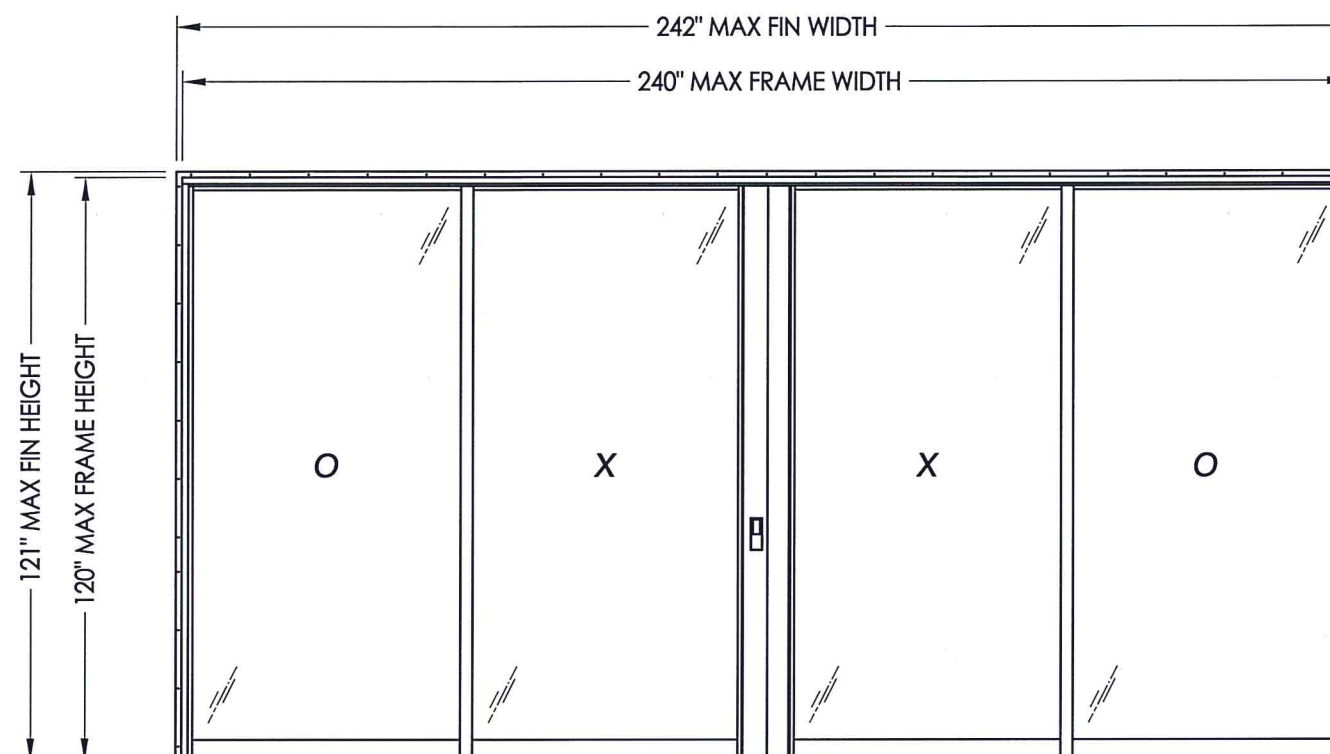


MAX PANEL DIMENSION	OVERALL D.L.O. DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)	
			POSITIVE	NEGATIVE
63.25" X 118.25"	54.75" X 112.75"	G1, G2	+40.0	-50.0
			+50.0*	-50.0




*Requires 3" sill pan.

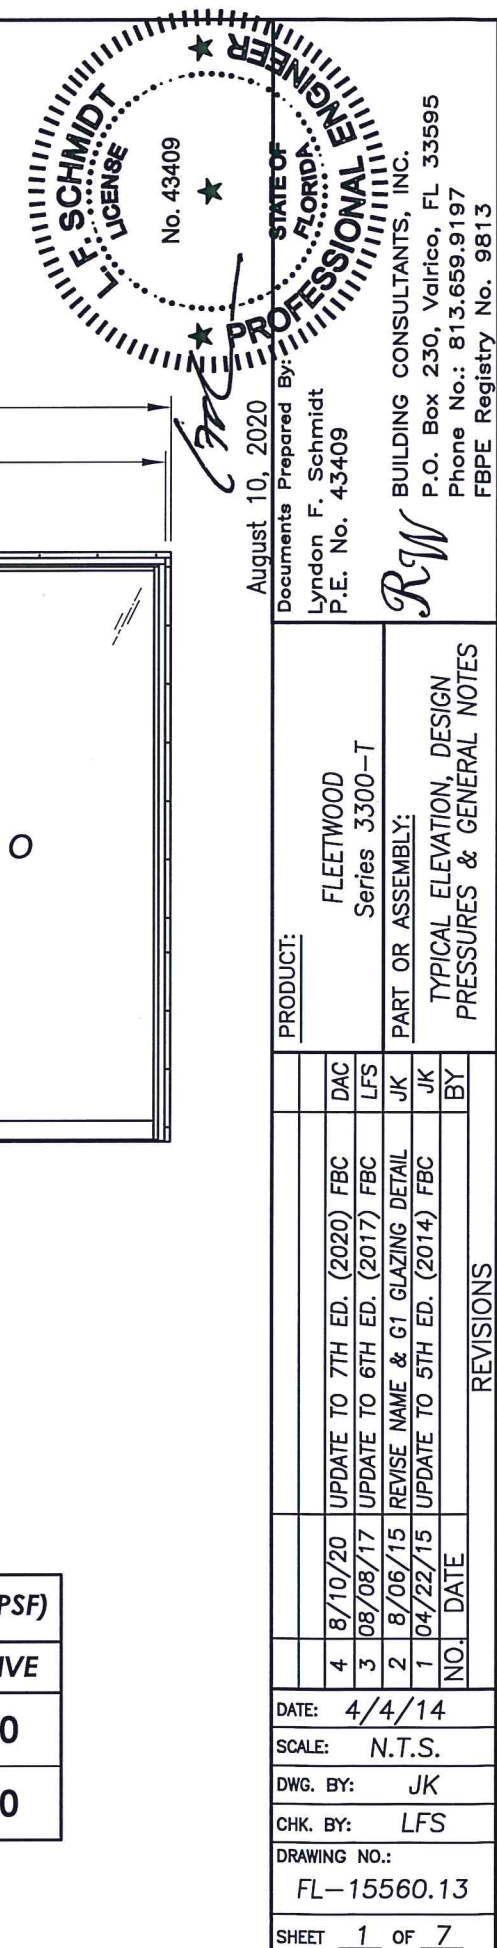


\\dc01\wbc\Clients\Fleetwood PERMANENT\A - Florida Product Approvals\FL-15560 Sliding Patio Doors\C - Drawings\FL 15560 (2020)\FL-15560.11-13.dwg

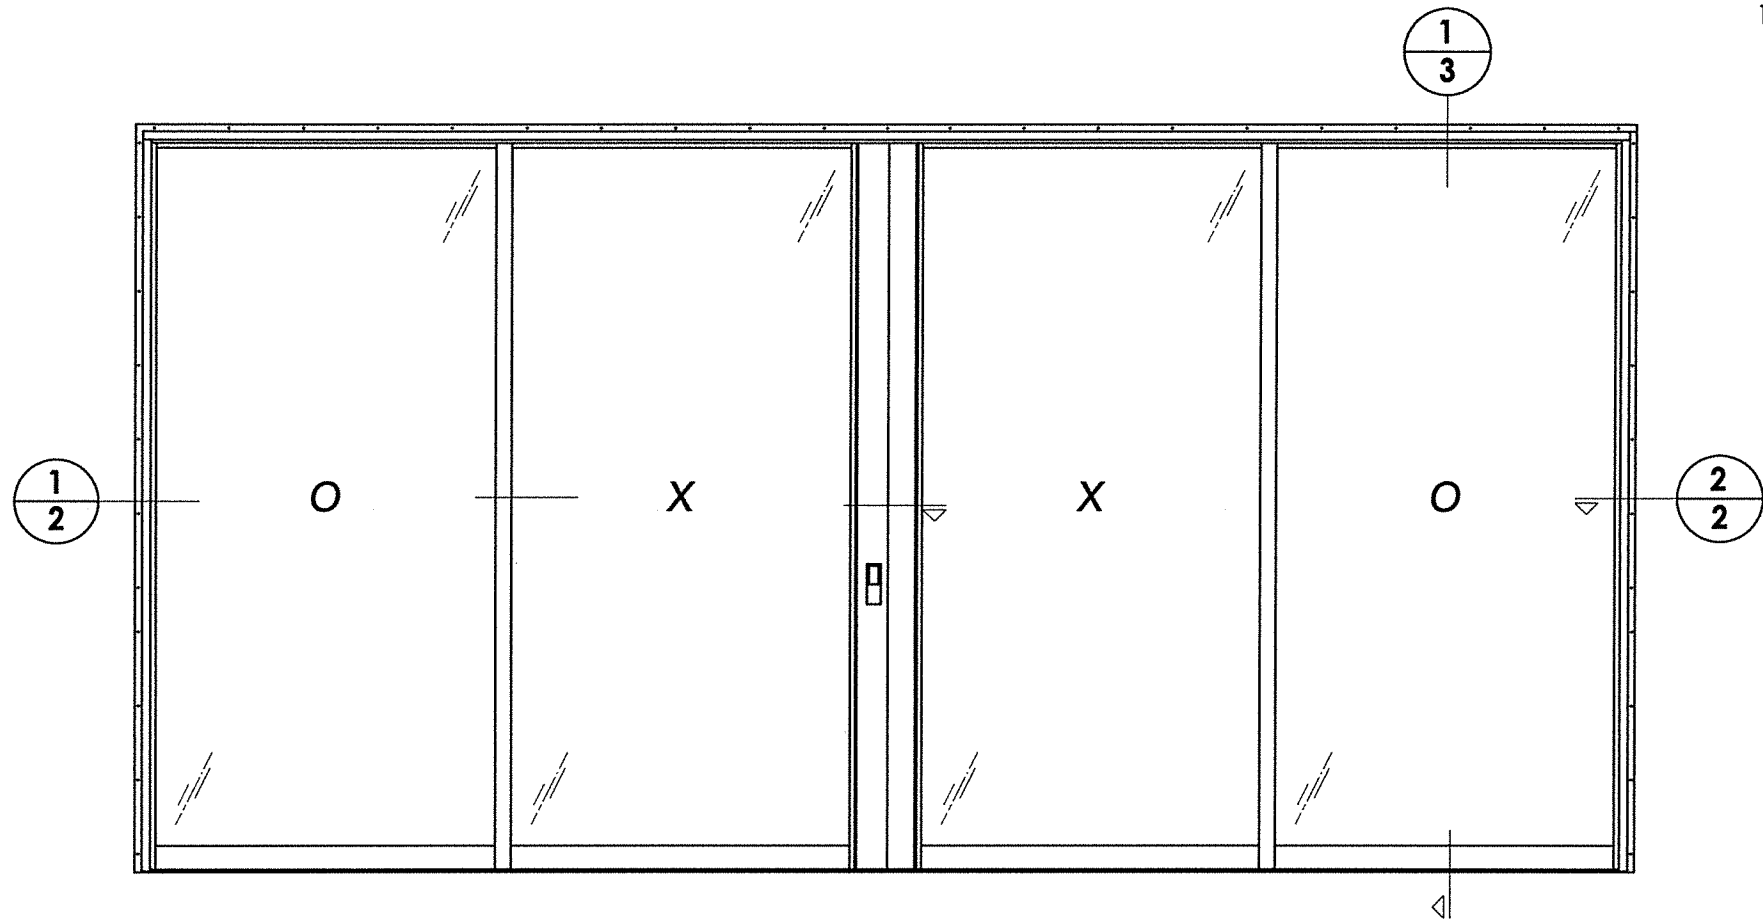


NOTE:
1. Item #J located six inches from
each end then 12" o.c.

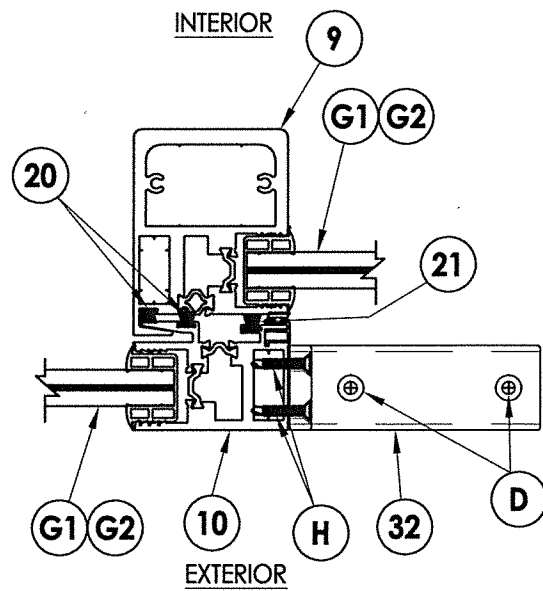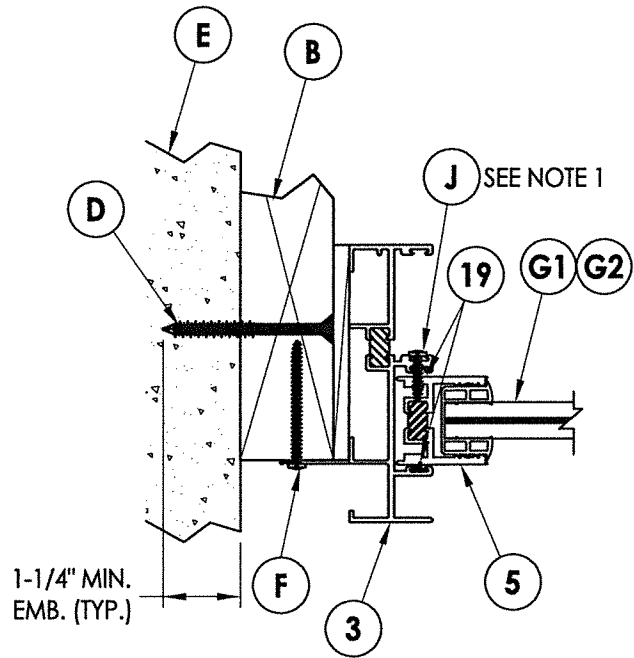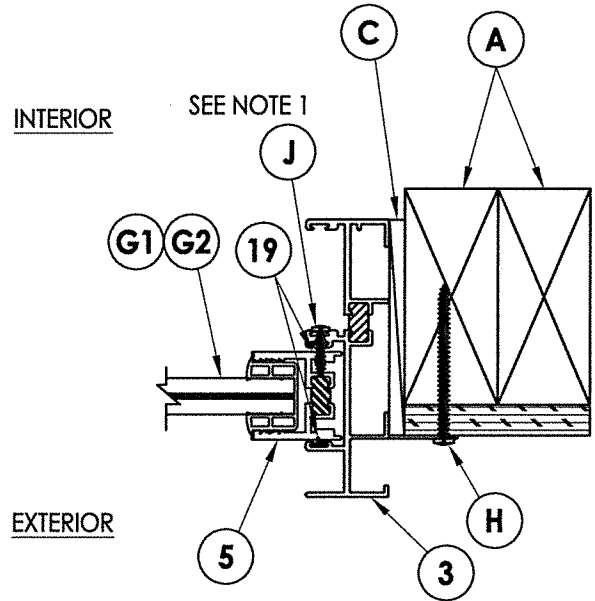

1 HORIZONTAL CROSS SECTION
2 2X Buck Construction

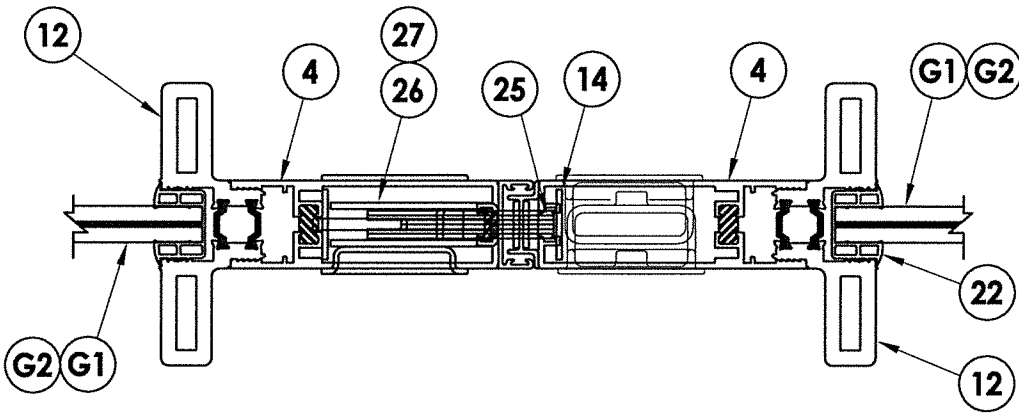

2 HORIZONTAL CROSS SECTION
2 2X Stud Construction

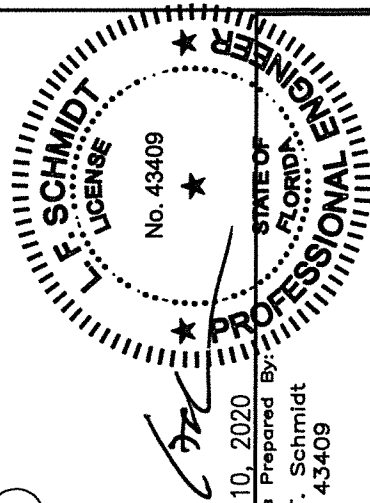

August 10, 2020

Documents Prepared By:

Lyndon F. Schmidt

P.E. No. 43409

BUILDING CONSULTANTS, INC.

P.O. Box 230, Valrico, FL 33595

Phone No.: 813.659.9197

FBPE Registry No. 9813

PRODUCT:		FLEETWOOD	
		Series 3300-T	
		PART OR ASSEMBLY:	
		HORIZONTAL CROSS SECTIONS	
NO.	DATE	REVISIONS	BY
4	8/10/20	UPDATE TO 7th ED. (2020) FBC	DAC
3	08/08/17	UPDATE TO 6TH ED. (2017) FBC	LFS
2	8/06/15	REVISE NAME & G1 GLAZING DETAIL	JK
1	04/22/15	UPDATE TO 5TH ED. (2014) FBC	JK

DATE: 4/4/14

SCALE: N.T.S.

DWG. BY: JK


CHK. BY: LFS

DRAWING NO.:

FL-15560.13

SHEET 2 OF 7

\\dc01\wbc\Clients\Fleetwood PERMANENTVA - Florida Product Approvals\FL-15560 (2020)\FL-15560.11-13.dwg

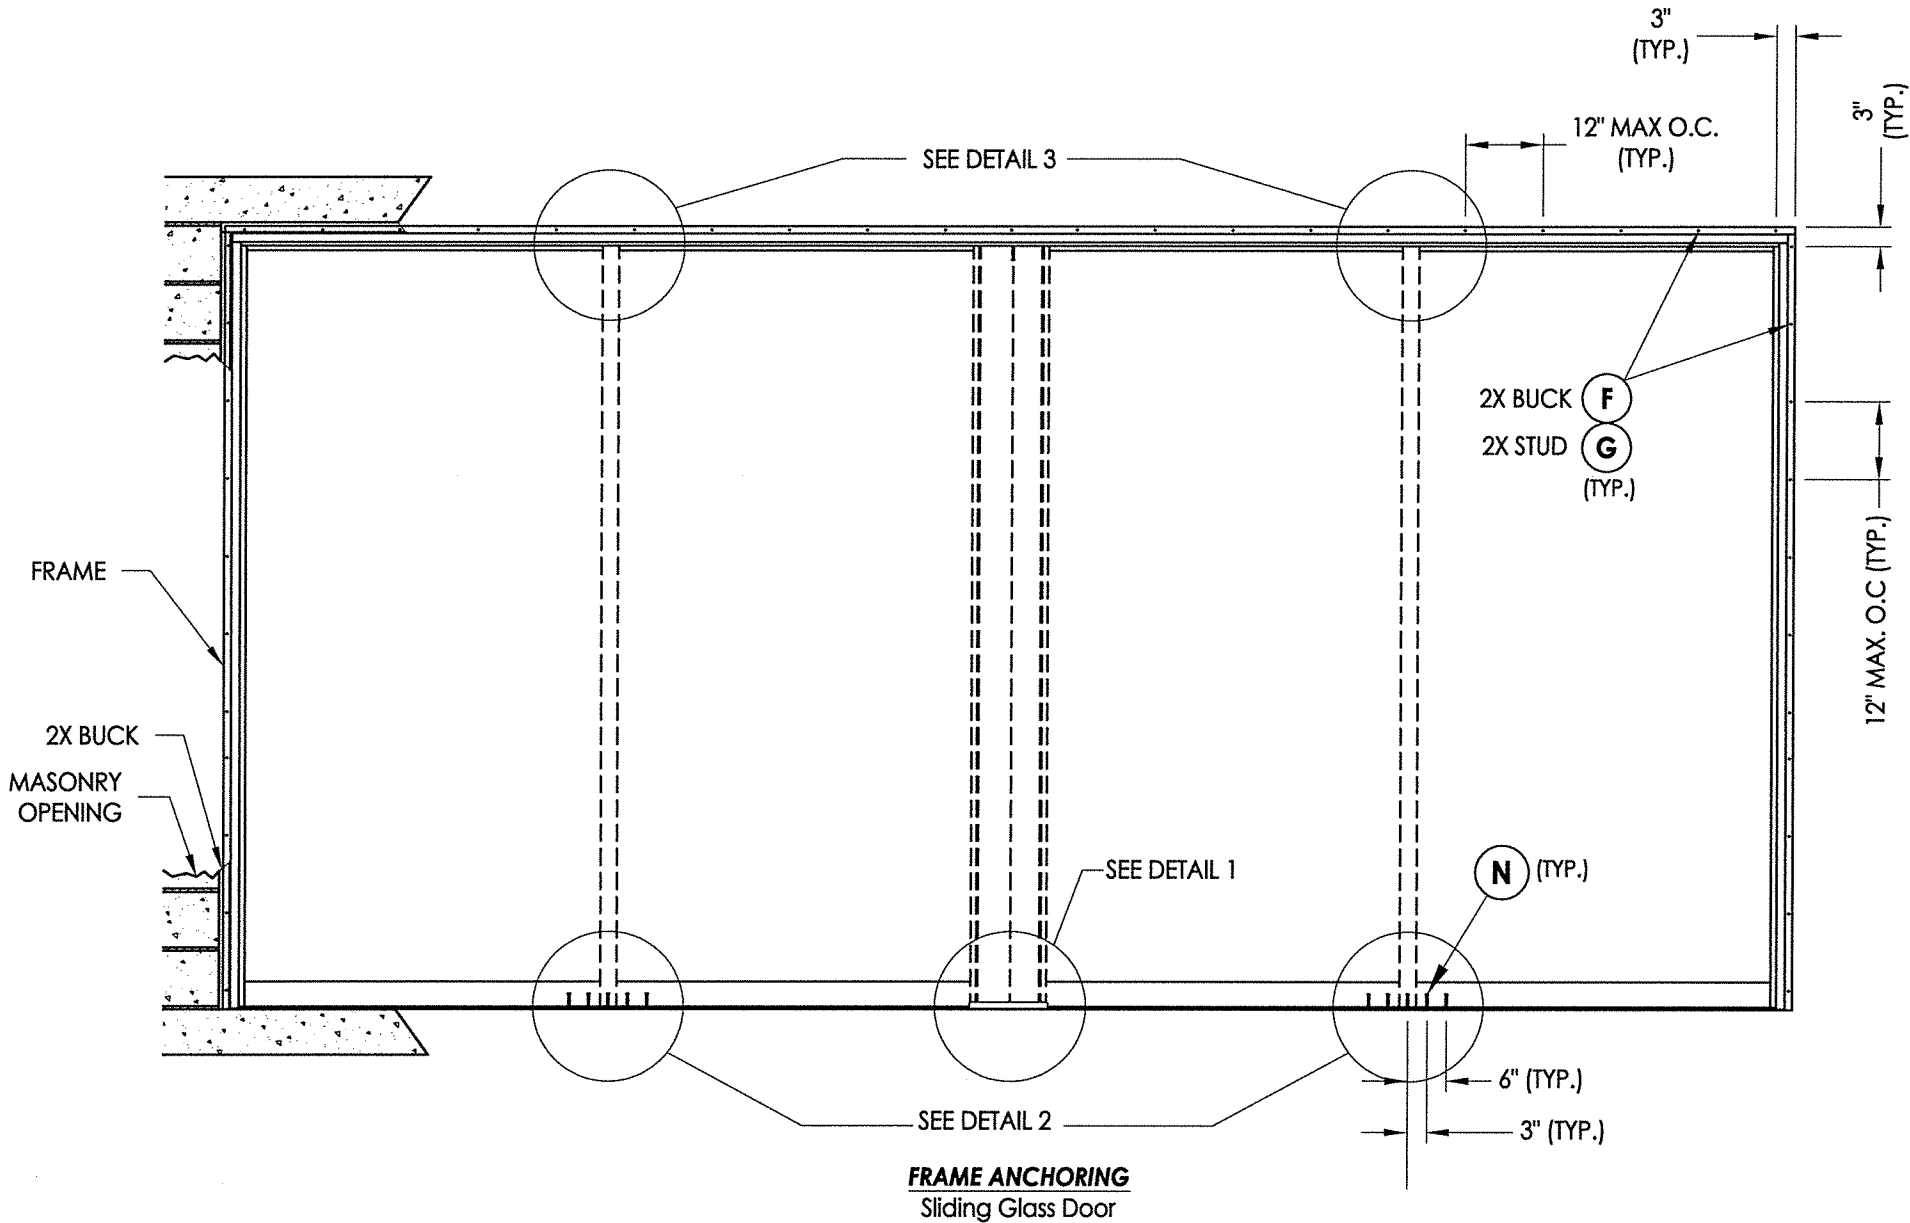

FRAME ANCHORING
Sliding Glass Door





CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
DeWALT ULTRACON [®]	1/4"	1-1/4" (Jambs) 1-3/4" (Head/Sill)	2-1/2"	2-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

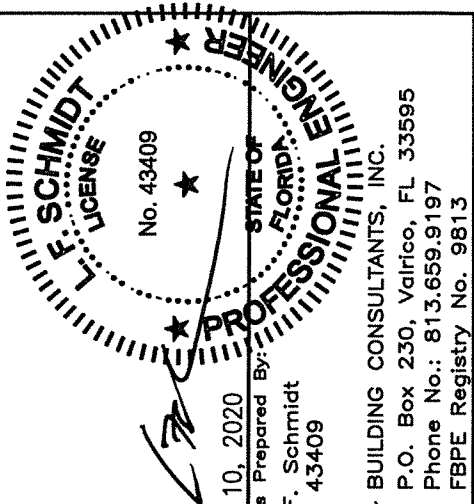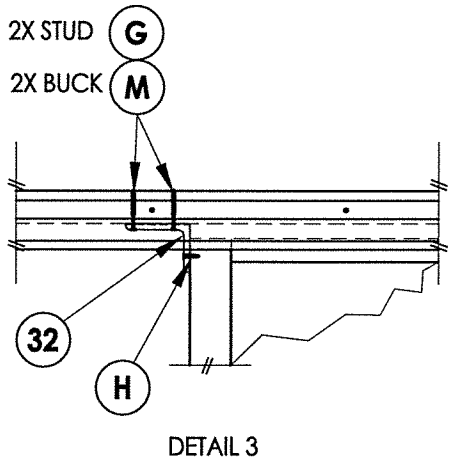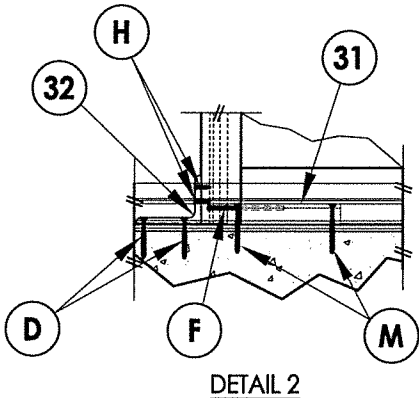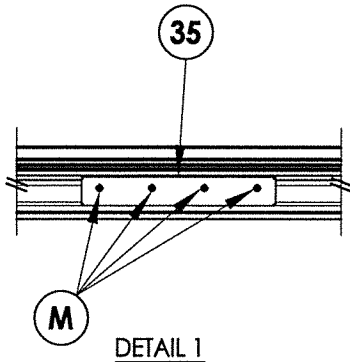

August 10, 2020
Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409
RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:	FLEETWOOD Series 3300-T
PART OR ASSEMBLY:	FRAME ANCHORING


NO.	DATE	REVISIONS
4	8/10/20	UPDATE TO 7TH ED. (2020) FBC
3	08/08/17	UPDATE TO 6TH ED. (2017) FBC
2	8/06/15	REVISE NAME & G1 GLAZING DETAIL
1	04/22/15	UPDATE TO 5TH ED. (2014) FBC

DATE:	4/4/14
SCALE:	N.T.S.
DWG. BY:	JK
CHK. BY:	LFS
DRAWING NO.:	FL-15560.13
SHEET	5 OF 7

Technical drawing of a rectangular plate with a central hole. The dimensions are: overall width 1.35", overall height 3.5", and a central hole diameter of 0.1". The drawing shows a cross-section of the plate with a central hole and a hatched area indicating a specific material or feature.

Technical drawing of a fixed interblock block. The top view shows a rectangular block with a width of 1.1" and a height of 0.625". A circular feature is centered on the top surface. The side view shows a rectangular block with a length of 3.5" and a height of 0.25". A circular feature is centered on the top surface.

32 L BRACKET



August 10, 2020
Documents Prepared By
Lyndon F. Schmidt
P.E. No. 43409


Radian BUILDING CONSULTANTS, INC.

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813


© 2014 R.W. BUILDING CONSULTANTS INC.

\\dc01\rbwc\Clients\Fleetwood PERMANENT\A - Florida Product Approvals\FL-15560 Sliding Patio Doors\C - Drawings\FL 15560 (2020)\FL-15560.11-13.dwg

BILL OF MATERIALS		
ITEM #	DESCRIPTION	MATERIAL
A	1X BUCK SG >= 0.55	WOOD
B	2X BUCK SG >= 0.55	
C	1/4" MAX. SHIM SPACE	
D	1/4" X 2-3/4" DeWALT CONCRETE SCREW	STEEL
E	MASONRY - 3,000 PSI MIN. CONCRETE CONFORMING TO ACI 301 OR HOLLOW BLOCK CONFORMING TO ASTM C90	CONCRETE
F	#10 X 2" PPH SMS (1-7/8" MIN. EMBEDMENT)	STEEL
G	#10 X 2-1/2" PPH SMS (1-7/8" MIN. EMBEDMENT)	STEEL
H	#10 X 1" PFH SMS	STEEL
J	#8 X 3/4" PPH SELF-DRILLING SMS	STEEL
L	1/4-20 X 1/2" MACHINE SCREW	STEEL
M	1/4" X 3-1/4" DeWALT PFH CONCRETE SCREW	STEEL
N	1/4" X 2-1/4" DeWALT PFH CONCRETE SCREW	STEEL
1	HEAD W/ NAIL FIN	6063-T6 ALUM
2	SILL	6063-T6 ALUM
3	JAMB W/ NAIL FIN	6063-T6 ALUM
4	LOCK STILE	6063-T6 ALUM
5	FIXED STILE	6063-T6 ALUM
6	TOP RAIL	6063-T6 ALUM
7	SLIDING BOTTOM RAIL	6063-T6 ALUM
8	FIXED BOTTOM RAIL	6063-T6 ALUM
9	HP INTERLOCK	6063-T6 ALUM
10	FIXED INTERLOCK	6063-T6 ALUM
11	HEAD CLOSER	6063-T6 ALUM
12	HIGH PERFORMANCE INTERLOCK STILE	6063-T6 ALUM
13	SLIDING BOTTOM RAIL WEATHER STRIP	-
14	LOCK STILE SPREADER	6063-T6 ALUM
15	BOTTOM RAIL SPREADER	6063-T6 ALUM
16	TOP RAIL ISOLATOR	6063-T6 ALUM
17	ISOLATOR	6063-T6 ALUM
18	S.S. TRACK	SS
19	2 FINGER VINYL	-
20	SMALL FINSEAL	-
21	LARGE FINSEAL	-
22	GLAZING VINYL (9/16" OR 1") SCR-900, 80 DUROMETER (TREMCO)	-
23	SILL ISOLATOR	6063-T6 ALUM
24	ROLLER ASSEMBLY	-
25	STRIKE PLATE ASSY.(JAMB)	-
26	LATCH ASSY.(JAMB)(Archetype Latch)	-
27	LATCH ASSY.(JAMB)(Archetype Narrow Latch)	-
28	SPACER (Archetype Narrow Latch)	-
30	THERMAL BREAK (Liquid Polyurethane by Azon, USA)	-
31	FIXED INTERLOCK BLOCK	6063-T6 ALUM
32	3" X 4" L-BRACKET	6063-T6 ALUM
35	SILL MEETING STILE BLOCK	6063-T6 ALUM
37	SILL PAN	ALUM

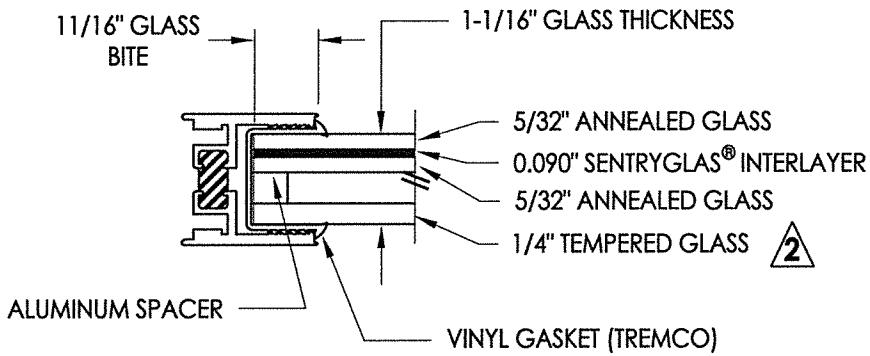


G1 GLAZING DETAIL

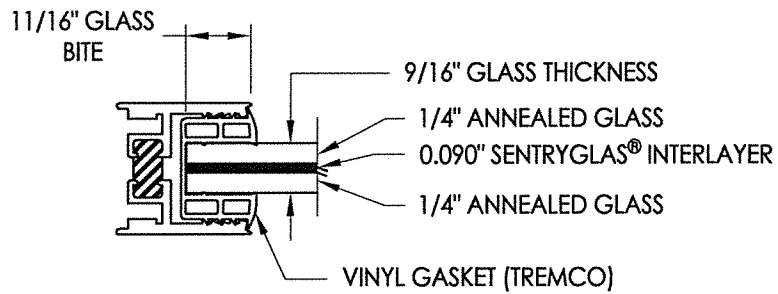


G2 GLAZING DETAIL


NOTE: GLAZING > 36" WIDE REQUIRES AT LEAST TWO (2) SETTING BLOCKS CONFORMING TO FBC SECTION 2411.3.3.1.

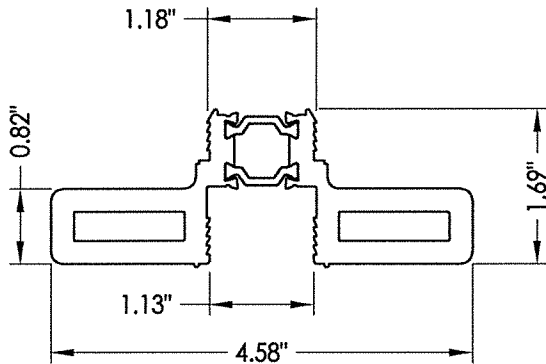

12 HP THERMAL ADAPTOR - DOUBLE WING

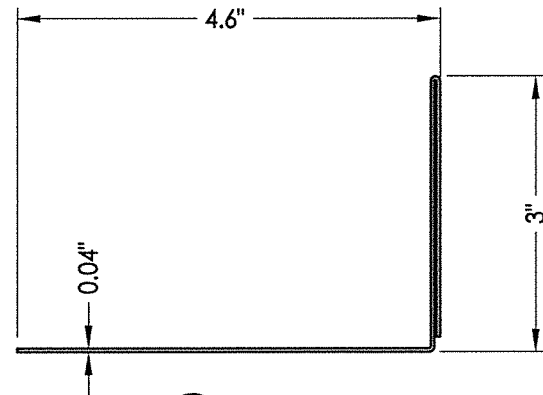

37 SILL PAN

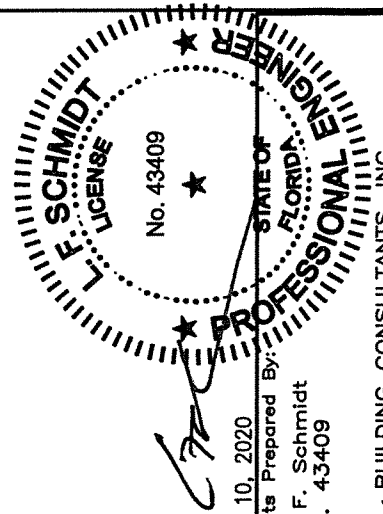

August 10, 2020
Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

RW BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:		FLEETWOOD	
		Series 3300-T	
PART OR ASSEMBLY:		BILL OF MATERIALS, COMPONENTS AND GLAZING DETAIL	
		DAC	JK
	UPDATE TO 7th ED. (2020) FBC	FBC	LFS
	UPDATE TO 6TH ED. (2017) FBC	FBC	JK
	REVISE NAME & G1 GLAZING DETAIL	FBC	JK
	UPDATE TO 5TH ED. (2014) FBC	FBC	JK
NO.	DATE	REVISIONS	
4	8/10/20	UPDATE TO 7th ED. (2020) FBC	
3	08/08/17	UPDATE TO 6TH ED. (2017) FBC	
2	8/06/15	REVISE NAME & G1 GLAZING DETAIL	
1	04/22/15	UPDATE TO 5TH ED. (2014) FBC	
DATE: 4/4/14			
SCALE: N.T.S.			
DWG. BY: JK			
CHK. BY: LFS			
DRAWING NO.: FL-15560.13			
SHEET 7 OF 7			