


GENERAL NOTES


1. This product has been evaluated and is in compliance with the 7th Edition (2020) Florida Building Code (FBC) structural requirements excluding the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment to base material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product is required to be protected with an impact resistant covering that complies with FBC Sections 1609.1.2 & R301.2.1.2.
4. For 2x stud framing construction, anchoring of these units shall be the same as that shown for 2x buck masonry construction.
5. Site conditions that deviate from the details of this drawing require further engineering analysis by a licensed engineer or registered architect.

TABLE OF CONTENTS	
SHEET#	DESCRIPTION
1	Typical elevations, design pressures and general notes
2	Horizontal cross sections
3	Vertical cross sections
4	Buck anchoring
5	Frame anchoring
6	Components
7	Bill of materials, components and glazing details

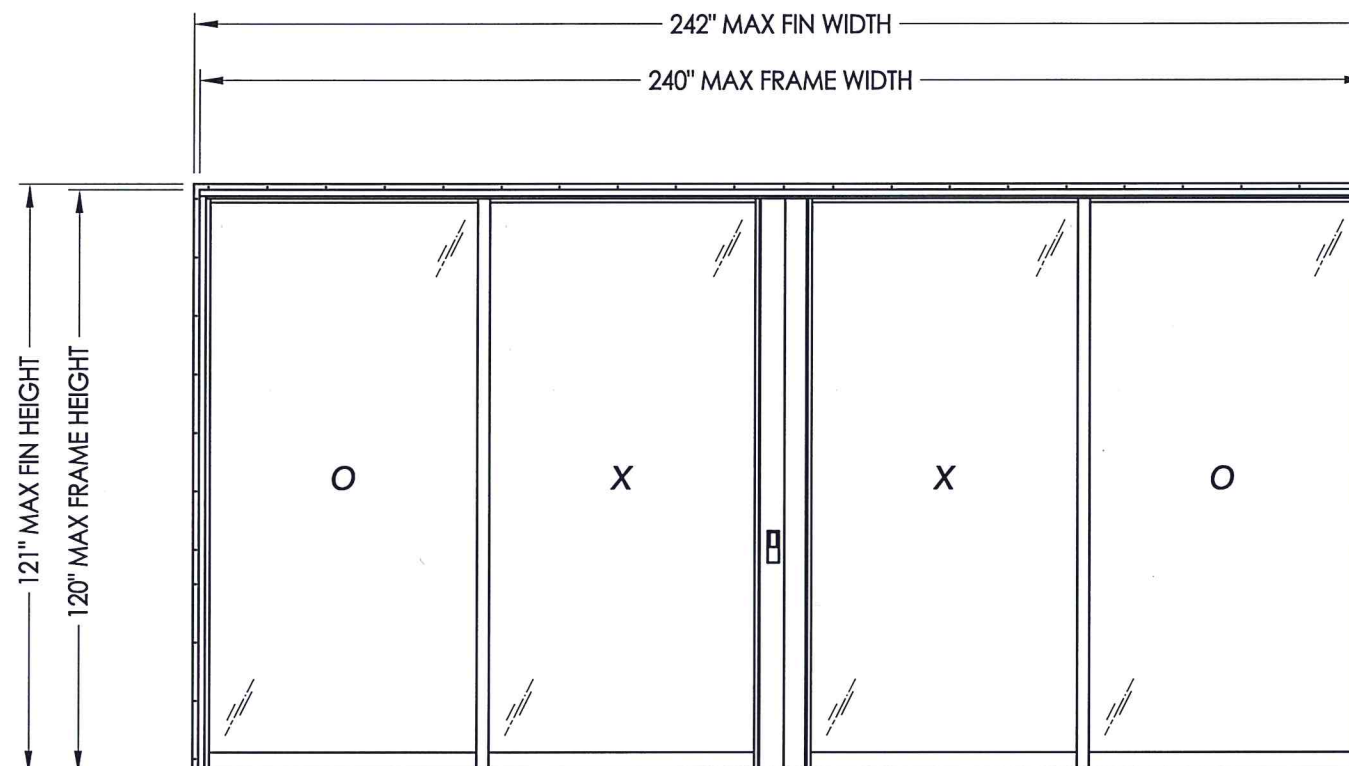

MAX PANEL DIMENSION	OVERALL D.L.O. DIMENSION	GLASS TYPE	DESIGN PRESSURE (PSF)	
			POSITIVE	NEGATIVE
62.0" X 118.25"	54.75" X 112.75"	G1	+40.0	-50.0
			+50.0*	-50.0

*Requires 3" sill pan.

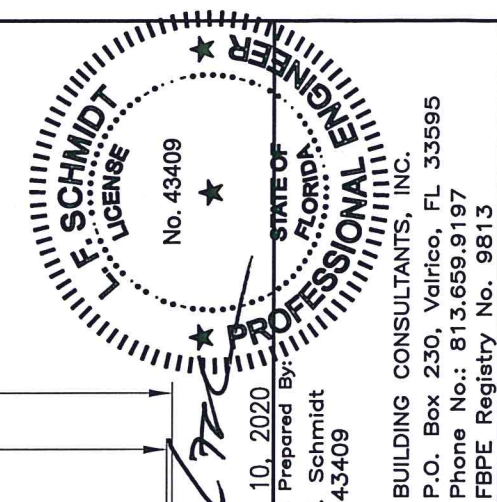

August 10, 2020

August 10, 2020
Documents Prepared By:
Lyndon F. Schmidt
P.E. No. 43409

 BUILDING CONSULTANTS, INC.

BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595

F.U. Box 230, Valrico, FL
Phone No.: 813.659.9197

FBPE Registry No. 9813

PRODUCT:

FLEETWOOD
Series 3300-T

PART OR ASSEMBLY: TYPICAL ELEVATION, DESIGN PRESSURES & GENERAL NOTES

4	8/10/20	UPDATE TO 7TH ED. (2020)	FBC	DAC
3	08/08/17	UPDATE TO 6TH ED. (2017)	FBC	LFS
2	8/06/15	REVISE NAME		JK
1	04/22/15	UPDATE TO 5TH ED. (2014)	FBC	JK
NO.	DATE			BY
REVISIONS				

DATE: 4/4/14

SCALE: N.T.S.


DWG. BY: JK

CHK. BY: LFS

DRAWING NO.:
FL-15560.16

SHEET 1 OF 7

\\dc01\rbwc\Clients\Fleetwood PERMANENT\A - Florida Product Approvals\FL-15560 Sliding Patio Doors\C - Drawings\FL 15560 (2020)\FL-15560.14-16.dwg

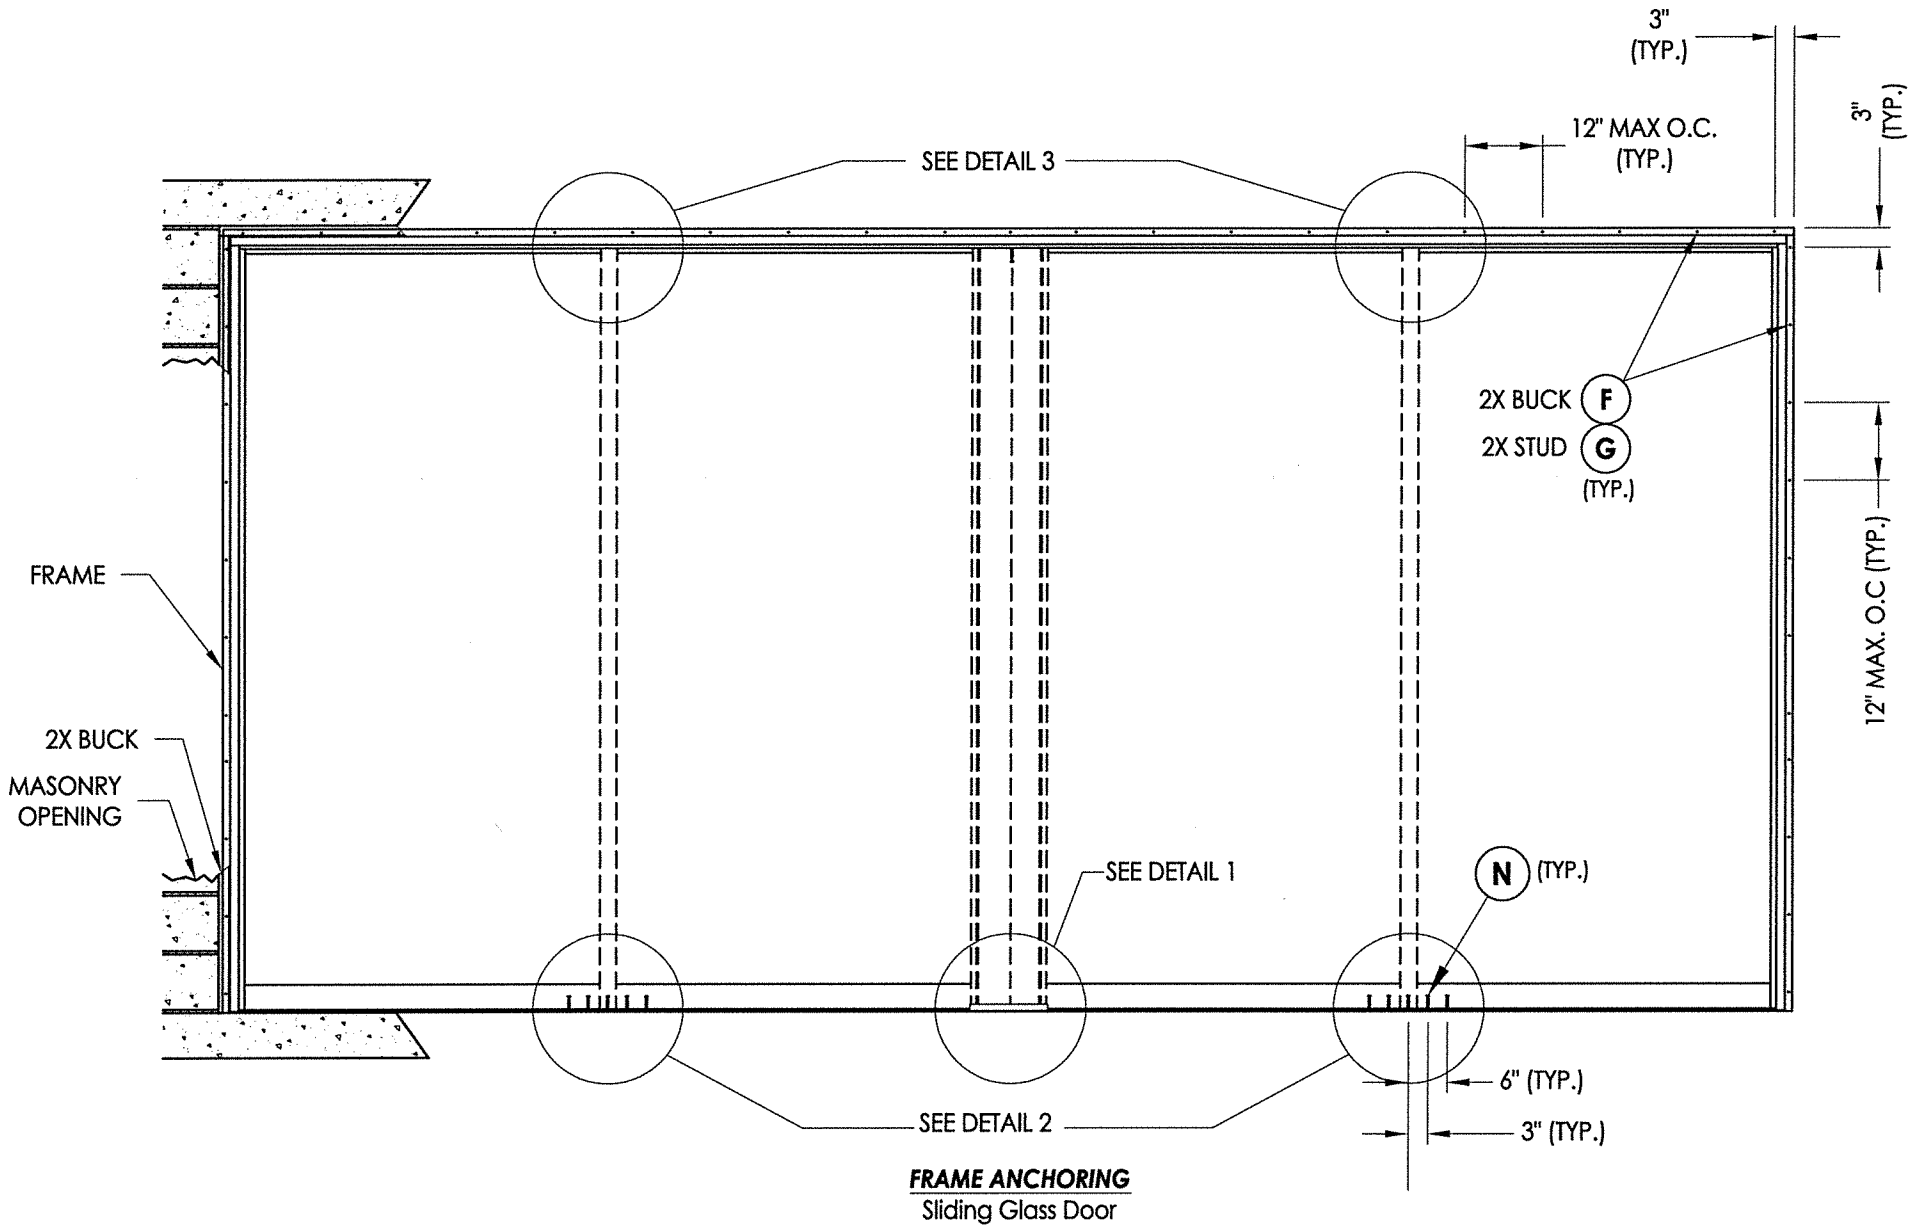





CONCRETE ANCHOR NOTES:

1. Concrete anchor locations at the corners may be adjusted to maintain the min. edge distance to mortar joints.
2. Concrete anchor locations noted as "MAX. ON CENTER" must be adjusted to maintain the min. edge distance to mortar joints, additional concrete anchors may be required to ensure the "MAX. ON CENTER" dimension are not exceeded.
3. Concrete anchor table:

ANCHOR TYPE	ANCHOR SIZE	MIN. EMBEDMENT	MIN. CLEARANCE TO MASONRY EDGE	MIN. CLEARANCE TO ADJACENT ANCHOR
DeWALT ULTRACON®	1/4"	1-1/4" (Jambs) 1-3/4" (Head/Sill)	2-1/2"	2-1/2"

WOOD SCREW INSTALLATION NOTES:

1. Maintain a minimum 5/8" edge distance, 1" end distance, & 1" o.c. spacing of wood screws to prevent the splitting of wood.

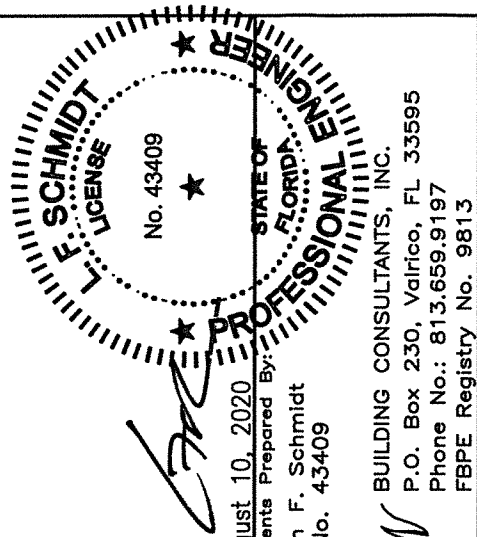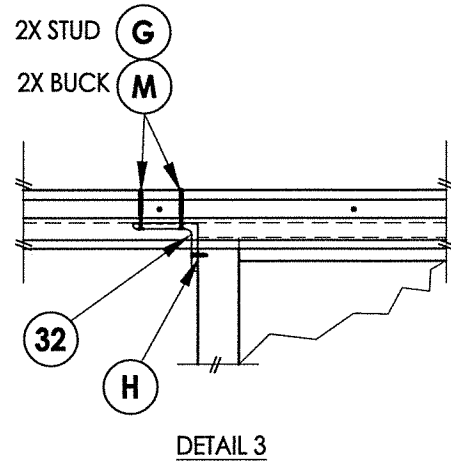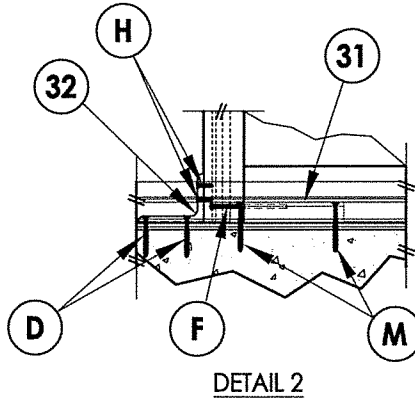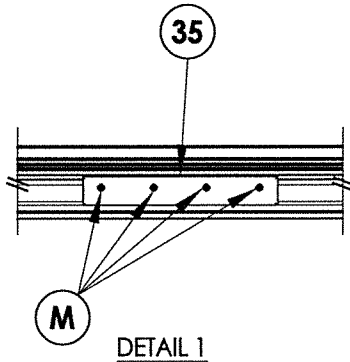

August 10, 2020

Documents Prepared By:

Lyndon F. Schmidt

P.E. No. 43409

RW
BUILDING CONSULTANTS, INC.
P.O. Box 230, Valrico, FL 33595
Phone No.: 813.659.9197
FBPE Registry No. 9813

PRODUCT:

FLEETWOOD

Series 3300-T

PART OR ASSEMBLY:

FRAME ANCHORING

REVISIONS

NO. DATE

1 04/22/15

2 08/06/15

3 08/08/17

4 8/10/20

UPDATE TO 7TH ED. (2020) FBC

UPDATE TO 6TH ED. (2017) FBC

DATE:

4/4/14

SCALE:

N.T.S.

DWG. BY:

JK

CHK. BY:

LFS

DRAWING NO.:

FL-15560.16


SHEET

5


OF

7


\\dc01\wbc\clients\Fleetwood PERMANENT\A - Florida Product Approvals\FL-15560 Sliding Patio Doors\C - Drawings\FL 15560 (2020)\FL-15560.14-16.dwg

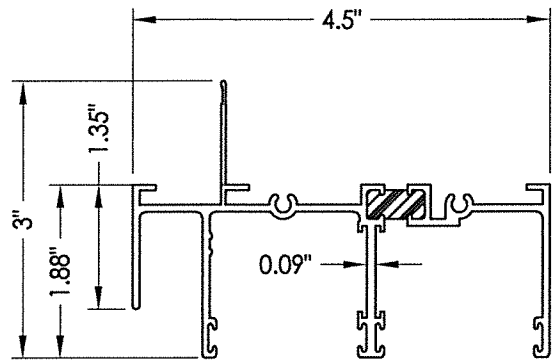


1 HEAD W/ NAIL FIN

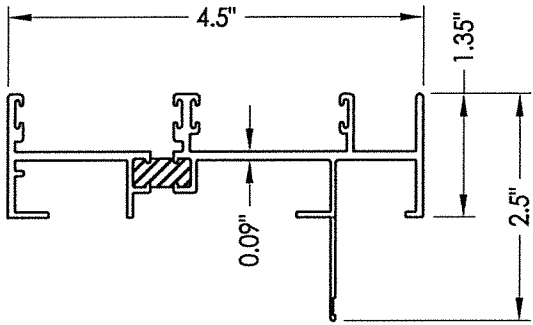


3 JAMB W/ NAIL FIN

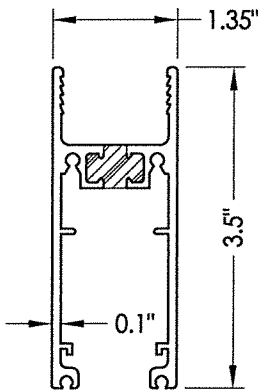


7 SLIDING BOTTOM RAIL

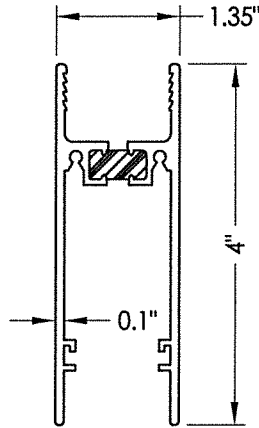


8 FIXED BOTTOM RAIL

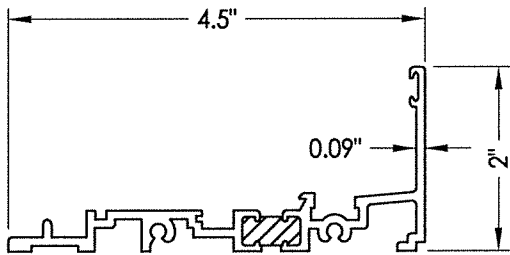


2 SILL

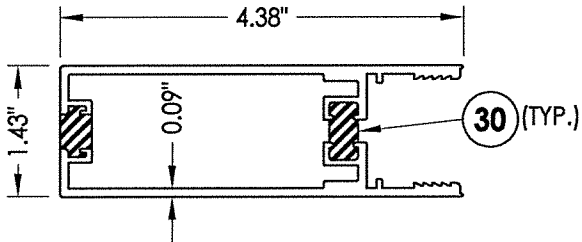


4 LOCK STILE




5 FIXED STILE




11 HEAD CHANNEL FILLER




18 TRACK

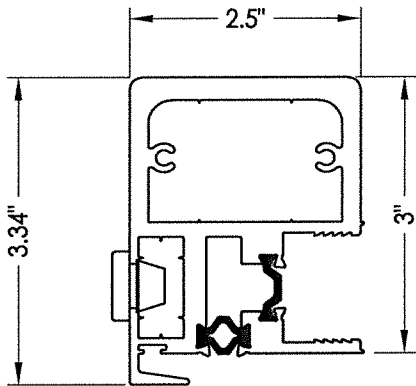


9 HP INTERLOCK

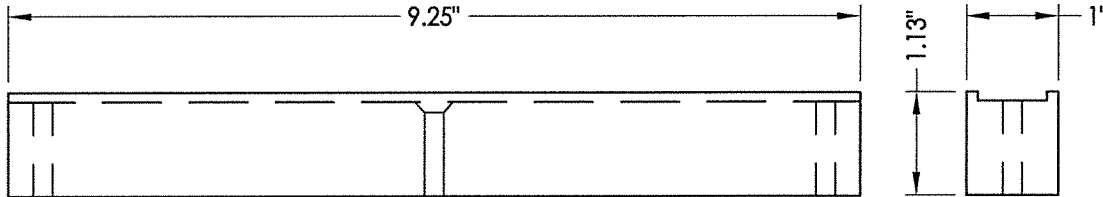


28 SPACER
Archetype Narrow Latch

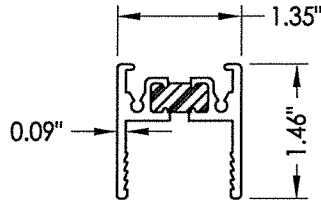


6 TOP RAIL

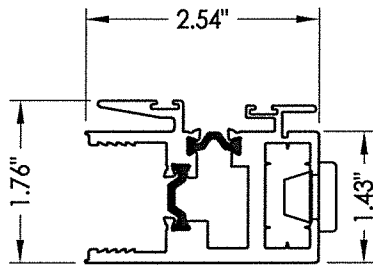


10 FIXED INTERLOCK

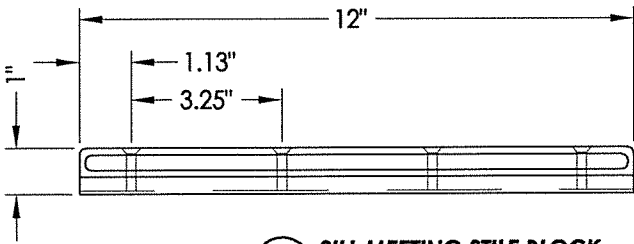



35 SILL MEETING STILE BLOCK

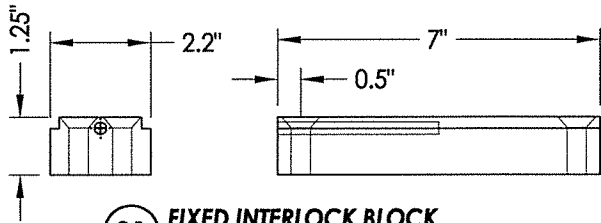

31 FIXED INTERLOCK BLOCK

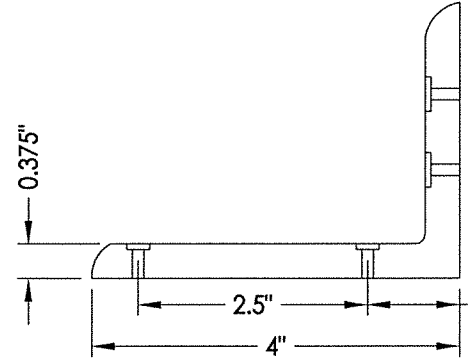

32 L BRACKET

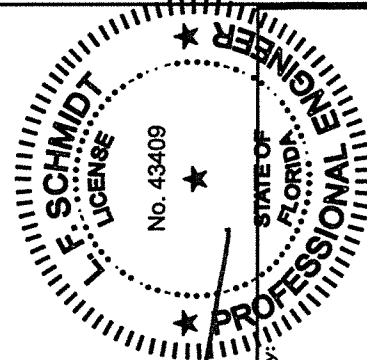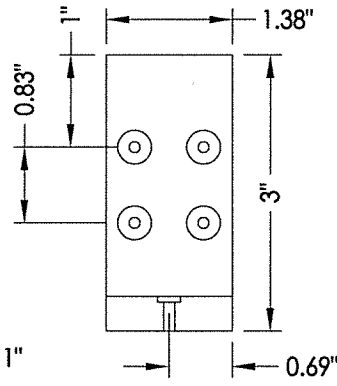

August 10, 2020

Documents Prepared By:

Lyndon F. Schmidt

P.E. No. 43409

Building Consultants, Inc.

P.O. Box 230, Valrico, FL 33595

Phone No.: 813.659.9197

FBPE Registry No. 9813

PRODUCT:

FLEETWOOD

Series 3300-T

PART OR ASSEMBLY:

COMPONENTS

DATE

BY

CHK

DATE

BY

CHK

DATE

DATE:

4/4/14

SCALE:

N.T.S.

DWG. BY:

JK

CHK. BY:

LFS

DRAWING NO.:

FL-15560.16



SHEET

6

OF

7

© 2014 R.W. BUILDING CONSULTANTS INC.

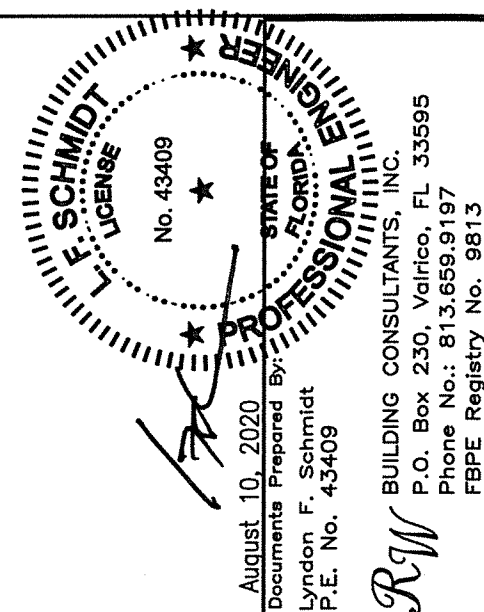

DATE:		4/4/14	
SCALE:		N.T.S.	
DWG. BY:		JK	
CHK. BY:		LFS	
DRAWING NO.:		FL-15560.16	
SHEET		7	OF 7